


Raw Water Treated Hadnot Point WTP Camp Lejeune, NC

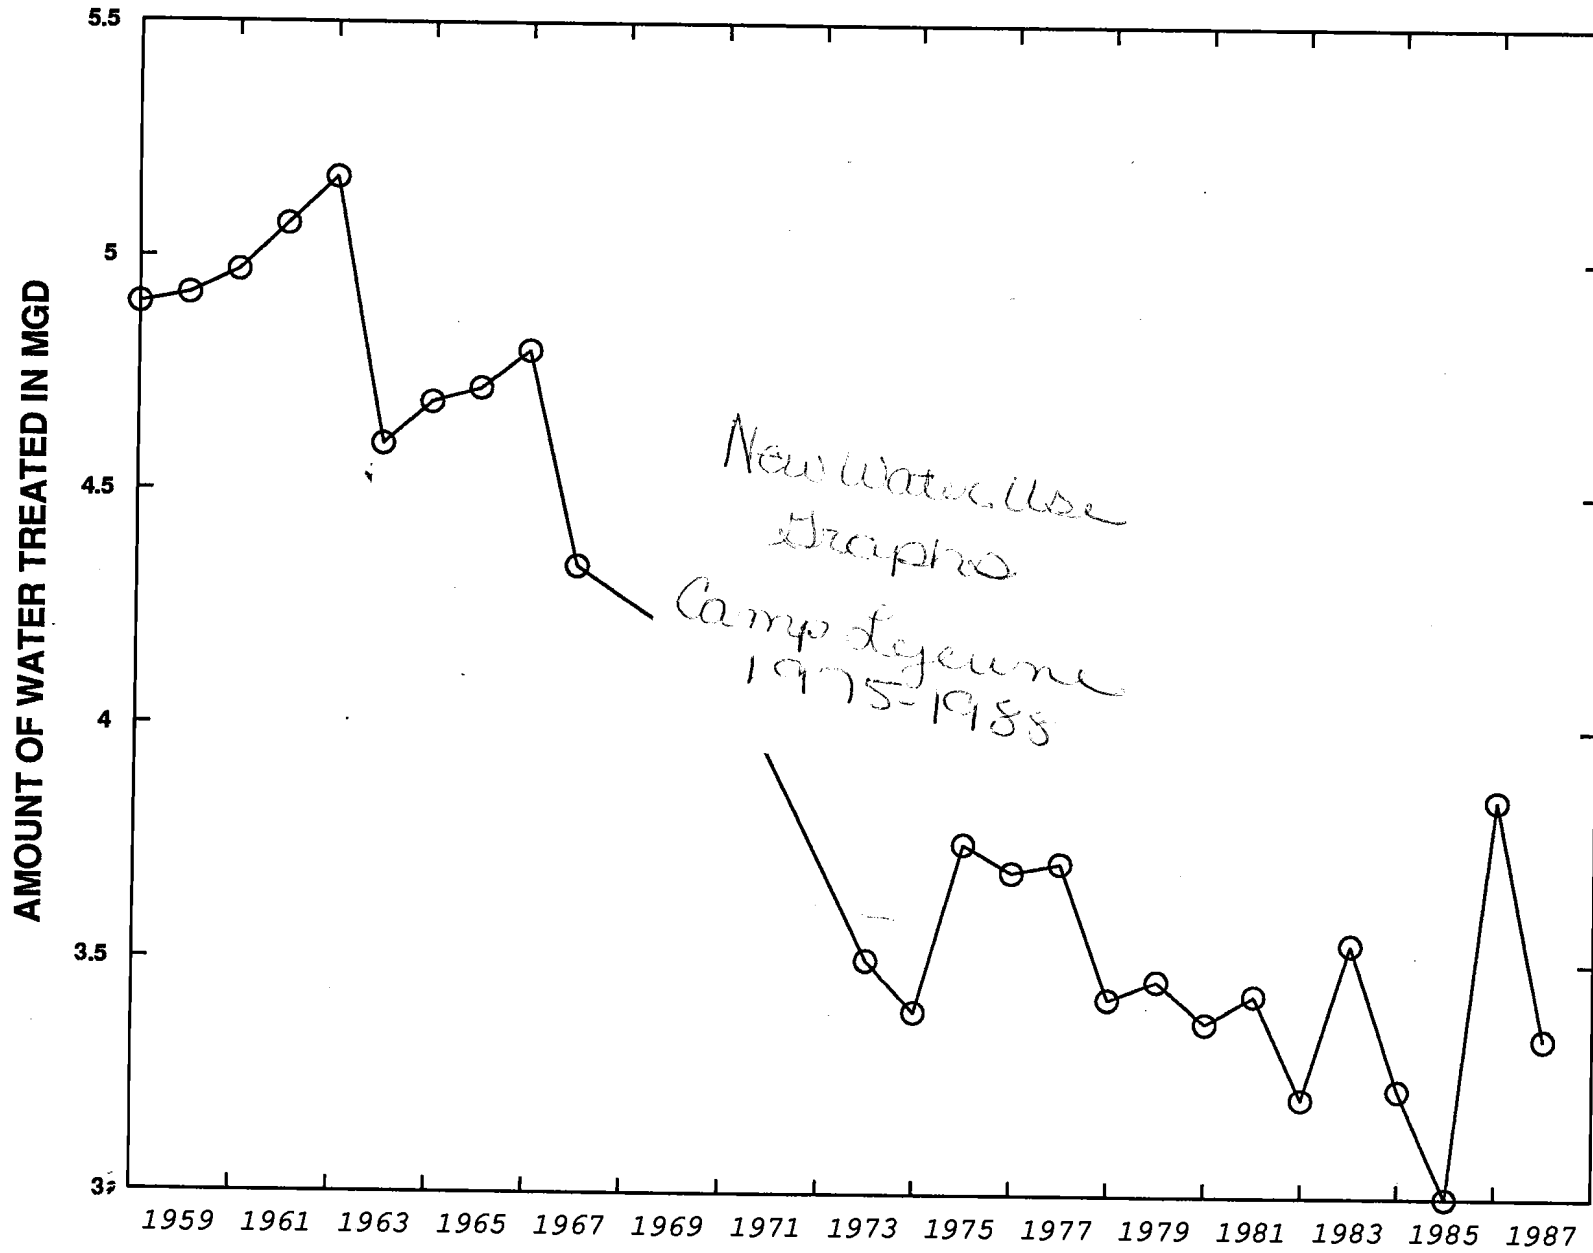


Raw Water Treated
HADNOT POINT WTP
CAMP LEJEUNE, NC


Hadnot Point

1959	4.9
1960	4.92
1961	4.97
1962	5.07
1963	5.17
1964	4.60
1965	4.69
1966	4.72
1967	4.80
1968	4.34
1971	4.13
1974	3.50
1975	3.39
1976	3.75
1977	3.69
1978	3.21
1979	3.42
1980	3.46
1981	3.37
1982	3.43
1983	3.21
1984	3.54
1985	3.23
1986	3.00
1987	3.85
1988	3.34


Raw Water Treated
Hadnot Point WTP
Camp Lejeune, NC

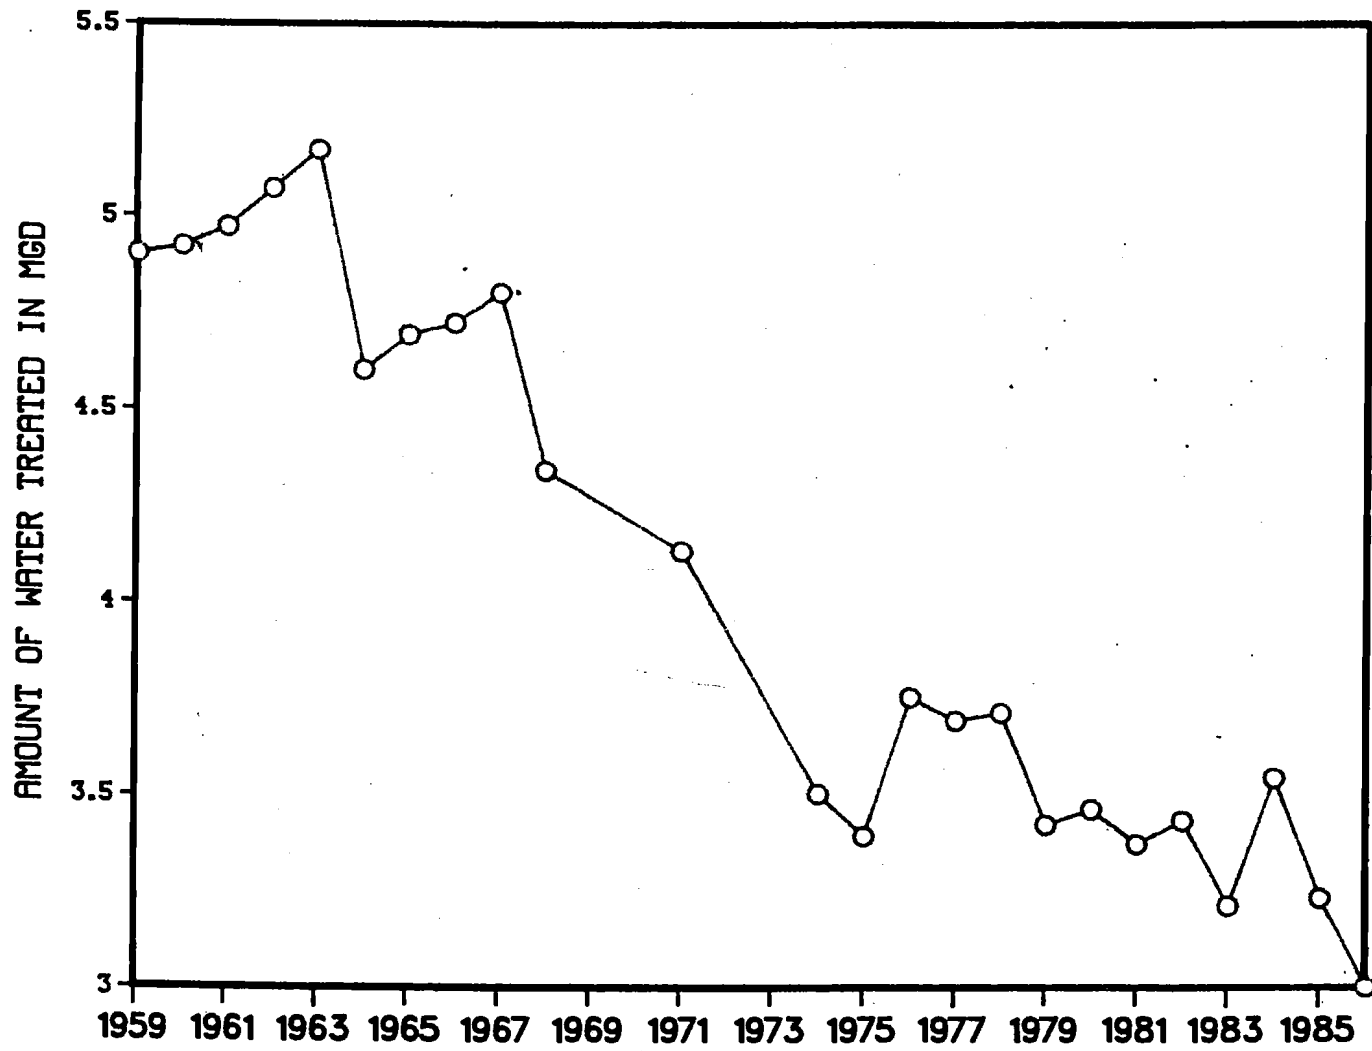

Raw Water Treated
Hadnot Point WTP
Camp Lejeune, NC

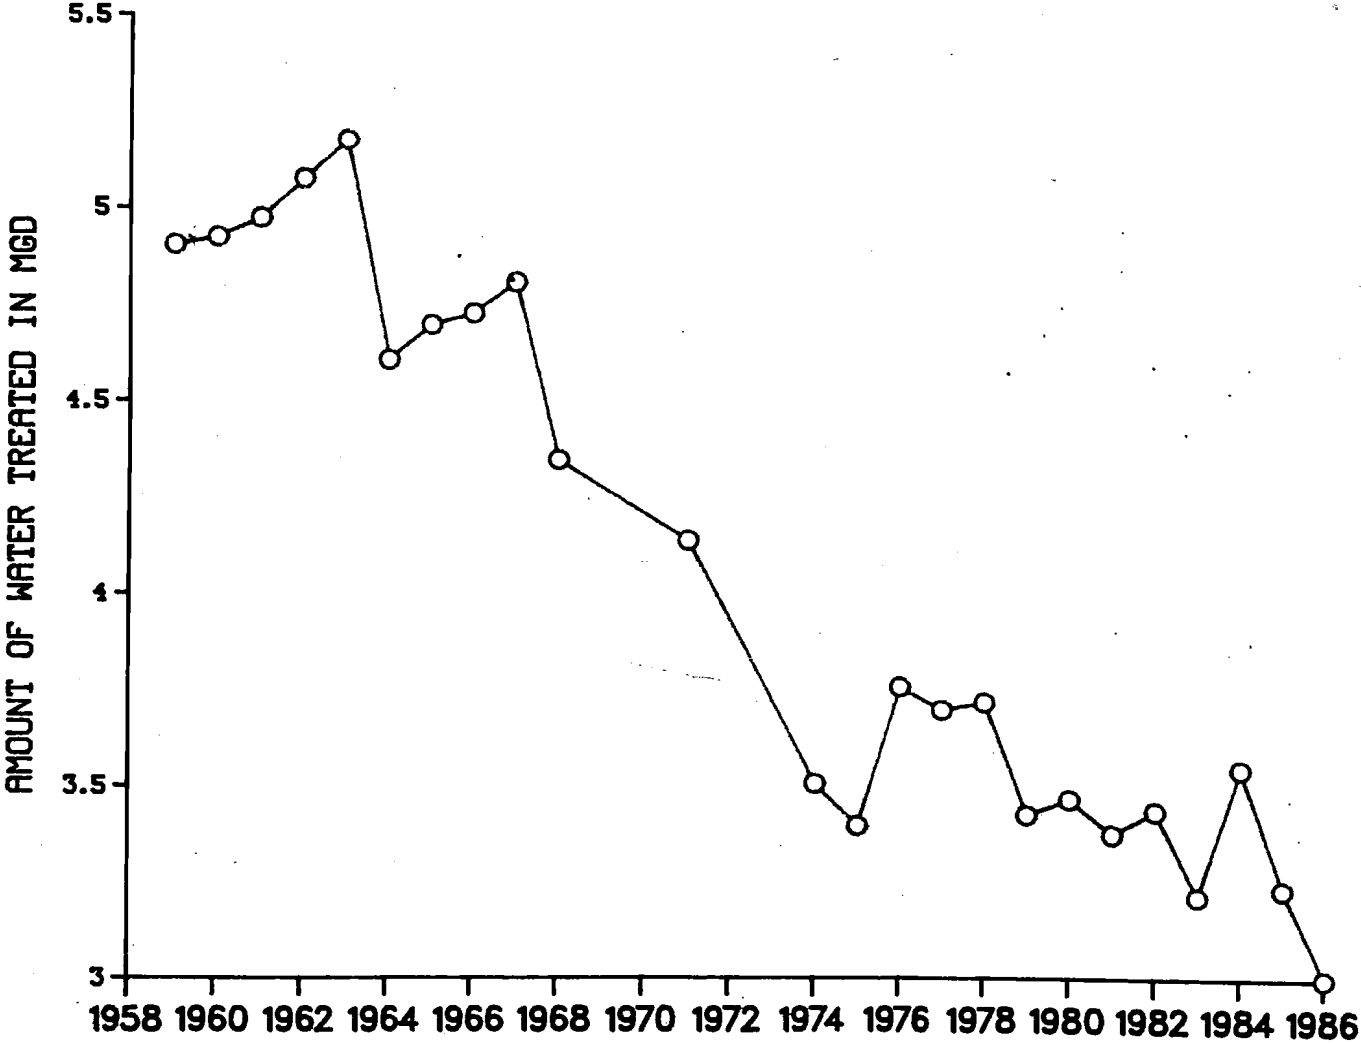

Raw Water Treated New River Air Station WTP Camp Lejeune, NC

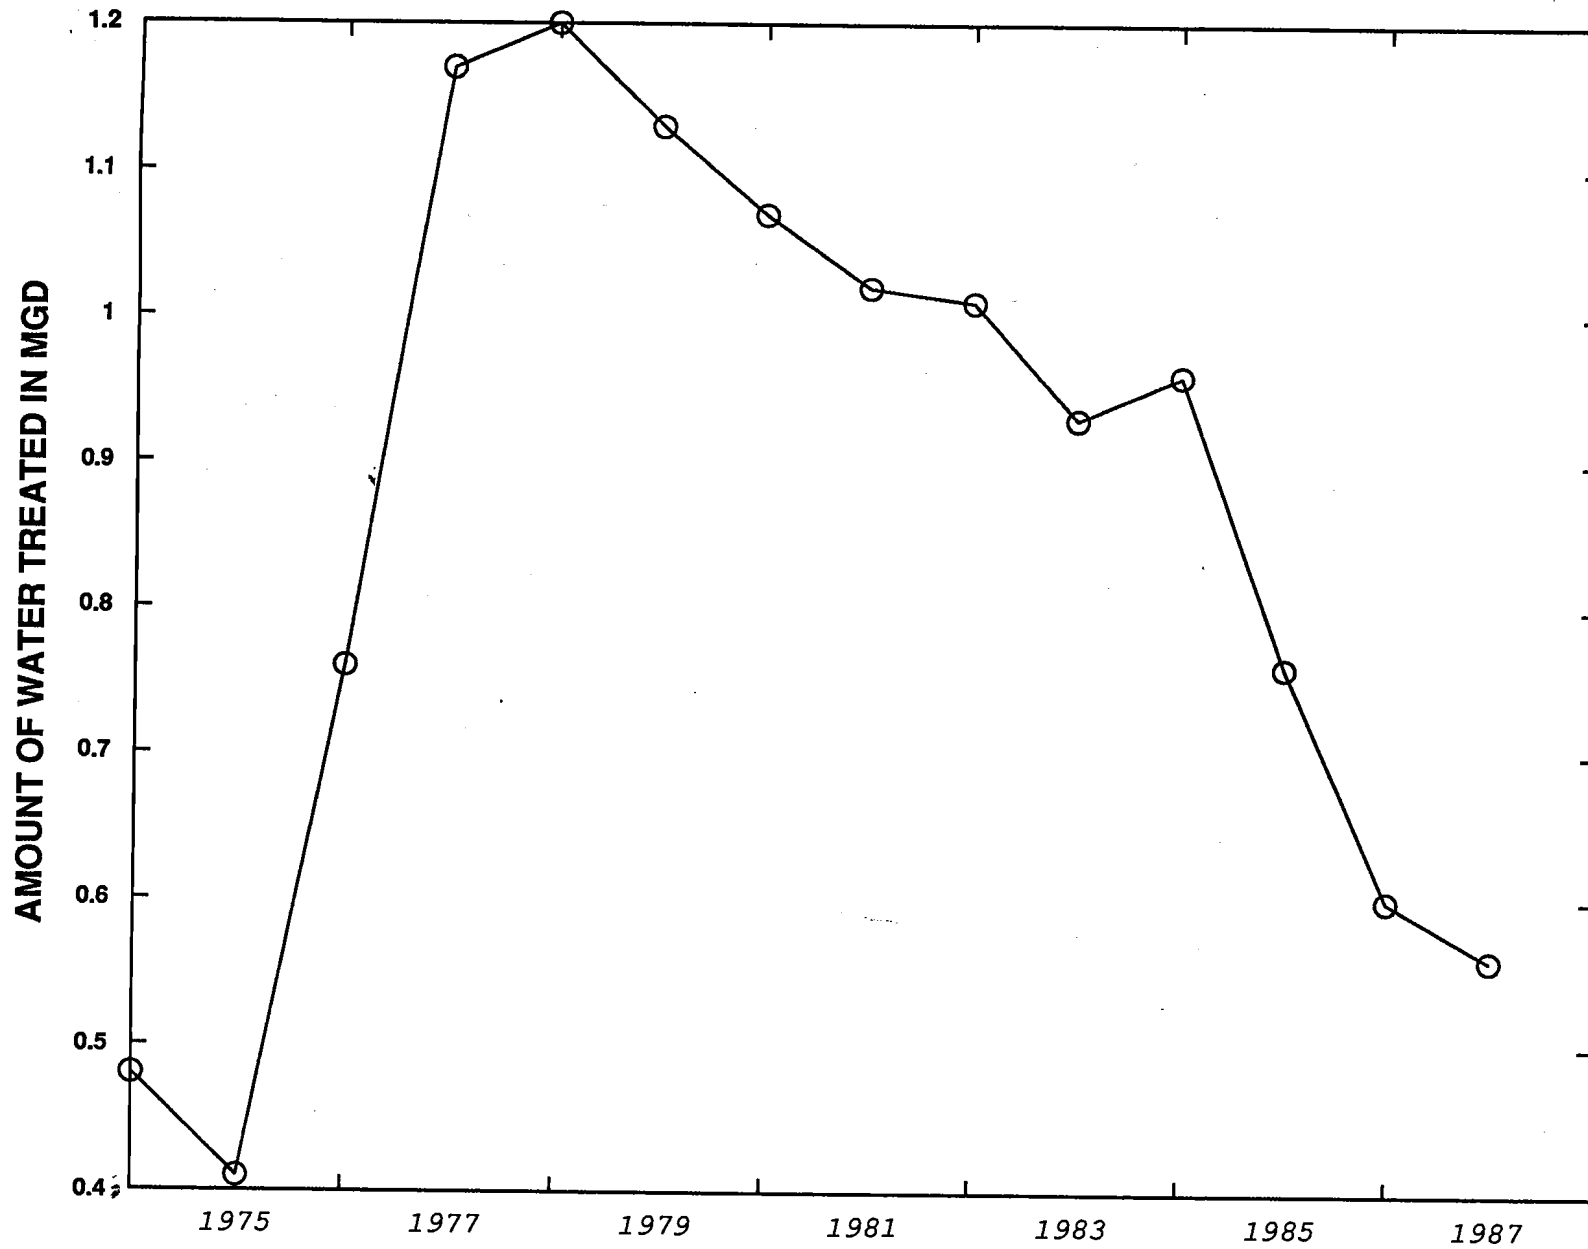


RAW WATER TREATED
NEW RIVER AIR STATION WTA
CAMP LEJEUNE, NC

MCAS

1975	0.48
1976	0.41
1977	0.76
1978	1.17
1979	1.20
1980	1.13
1981	1.07
1982	1.02
1983	1.01
1984	0.93
1985	0.96
1986	0.76
1987	0.60
1988	0.56

Raw Water Treated Rifle Range WTP Camp Lejeune, NC

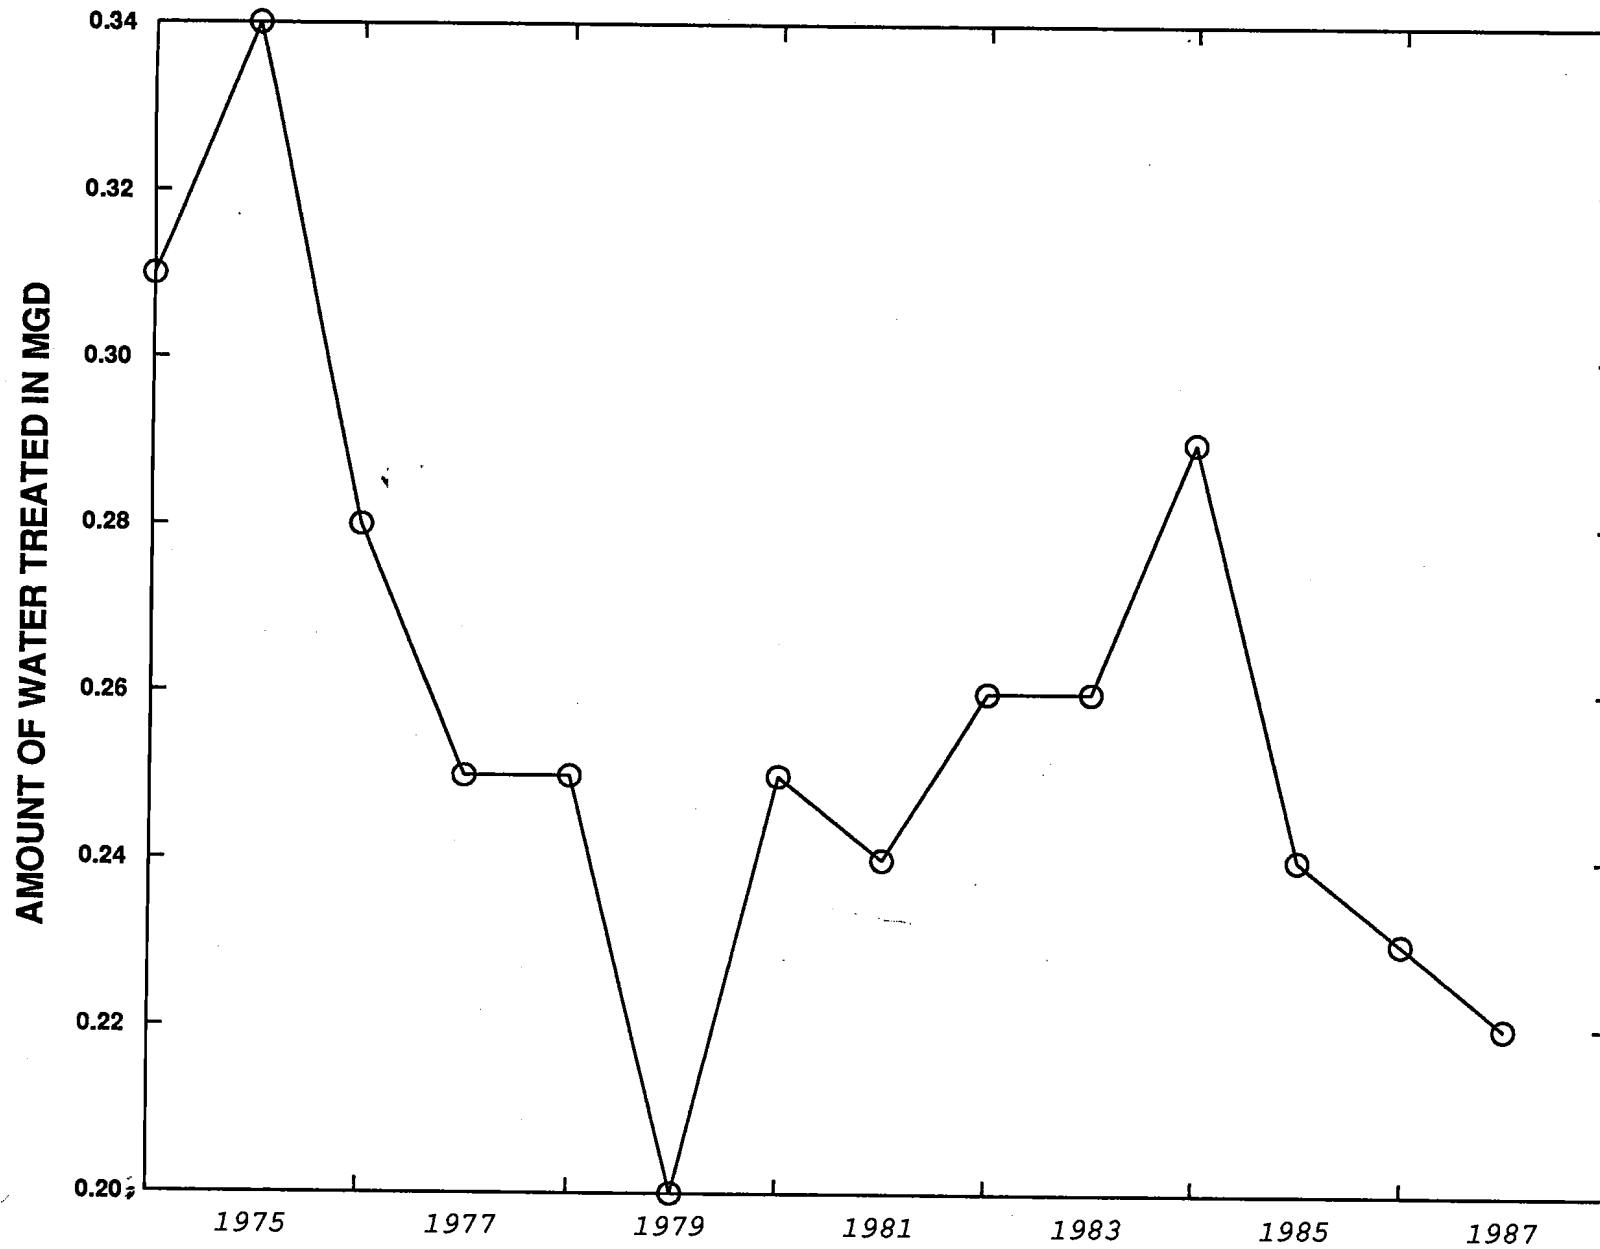


RAW WATER TREATED
RIFLE RANGE WTP
CAMP LEJEUNE, NC

R. C. K. Rerger

1975	0.31
1976	0.34
1977	0.28
1978	0.25
1979	0.25
1980	0.20
1981	0.25
1982	0.24
1983	0.26
1984	0.26
1985	0.29
1986	0.24
1987	0.23
1988	0.22

Raw Water Treated Tarawa Terrace WTP Camp Lejeune, NC

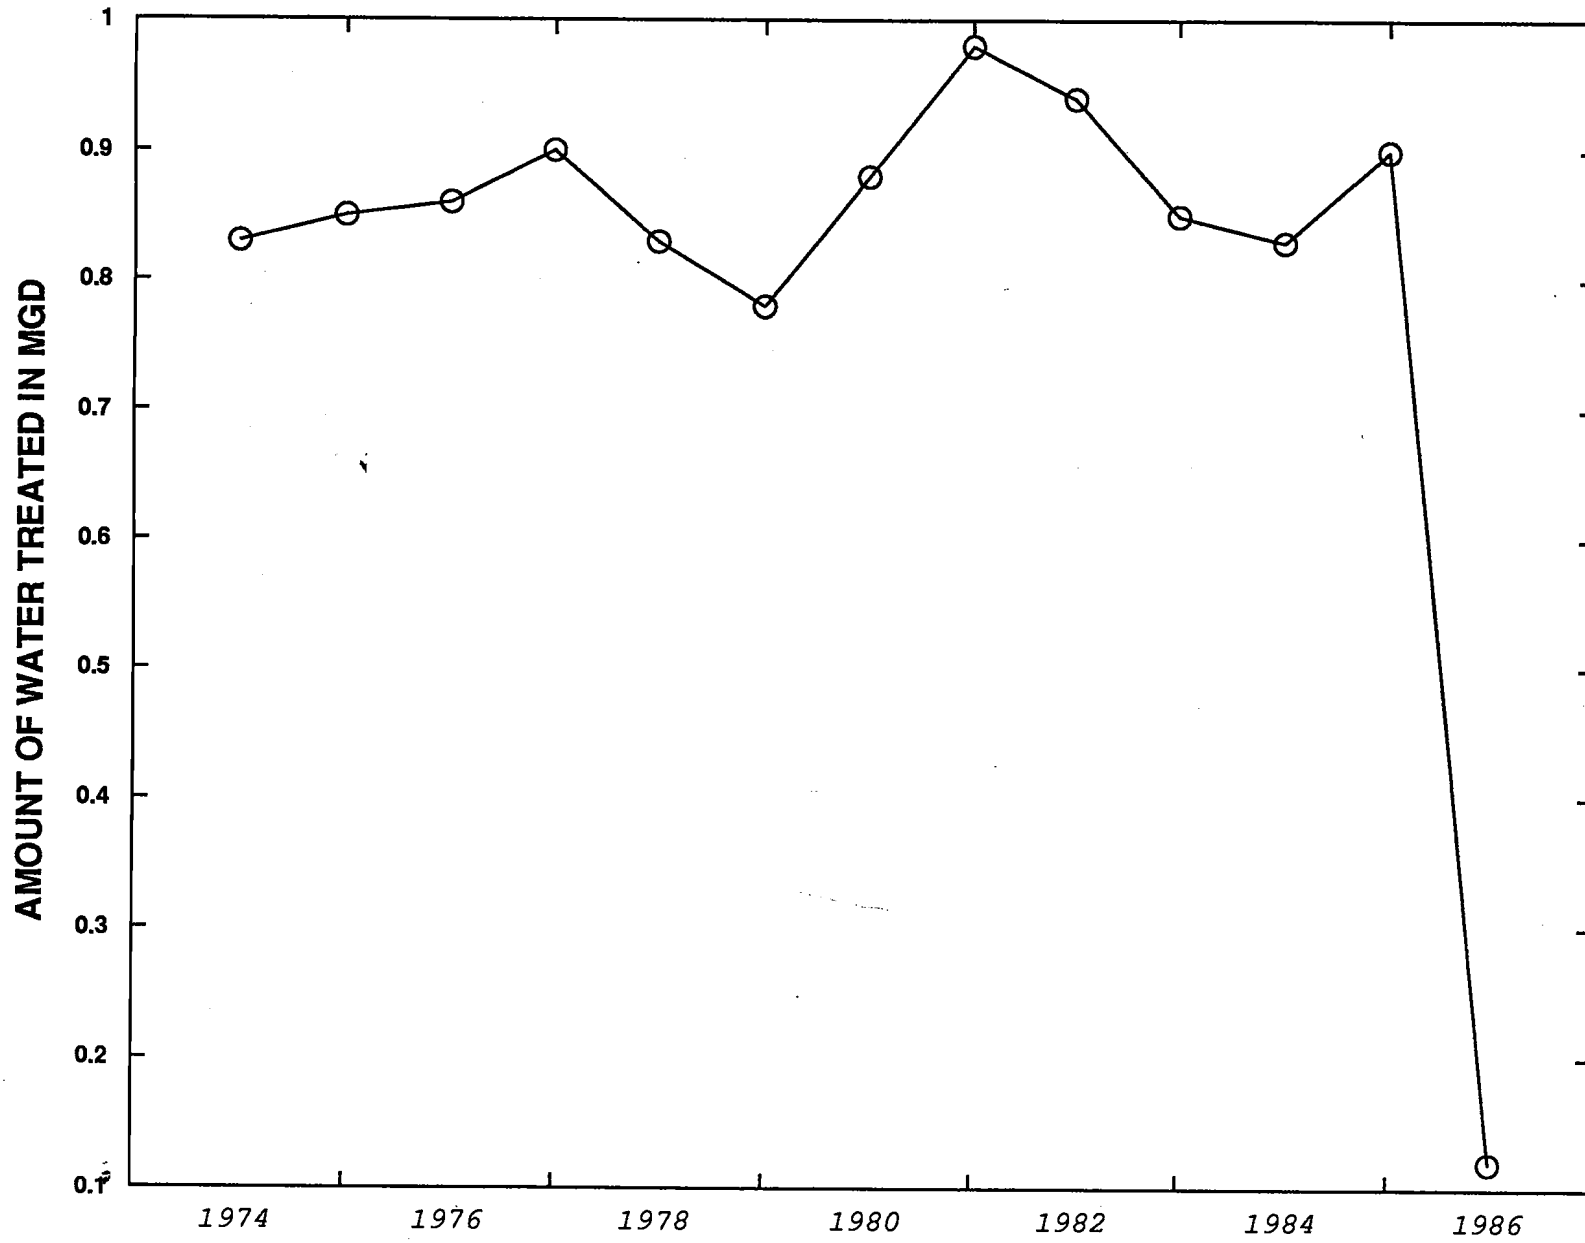


RAW WATER TREATED
TARAWA TERRACE WTP
CAMP LEJEUNE, NC


Tarawa Terrace -

1975	0.83
1976	0.85
1977	0.86
1978	0.90
1979	0.83
1980	0.78
1981	0.88
1982	0.98
1983	0.94
1984	0.85
1985	0.83
1986	0.90
1987	0.12

RAW WATER TREATED
TARAWA TERRACE WTP
CAMP LEJEUNE, NC

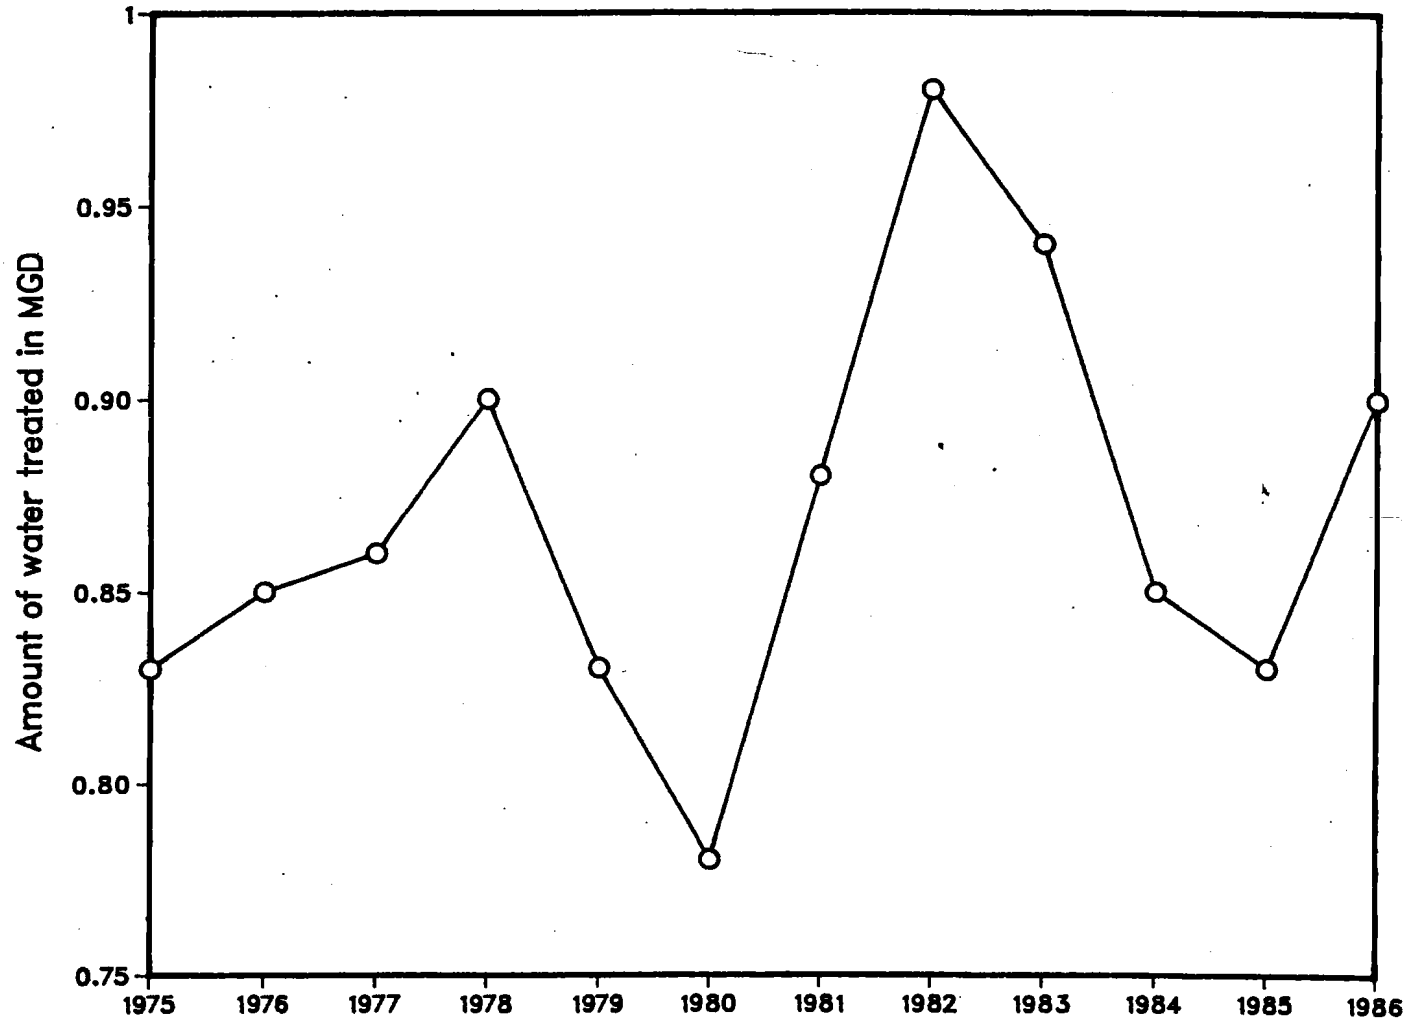

Raw Water Treated Holcomb Blvd WTP Camp Lejeune, NC

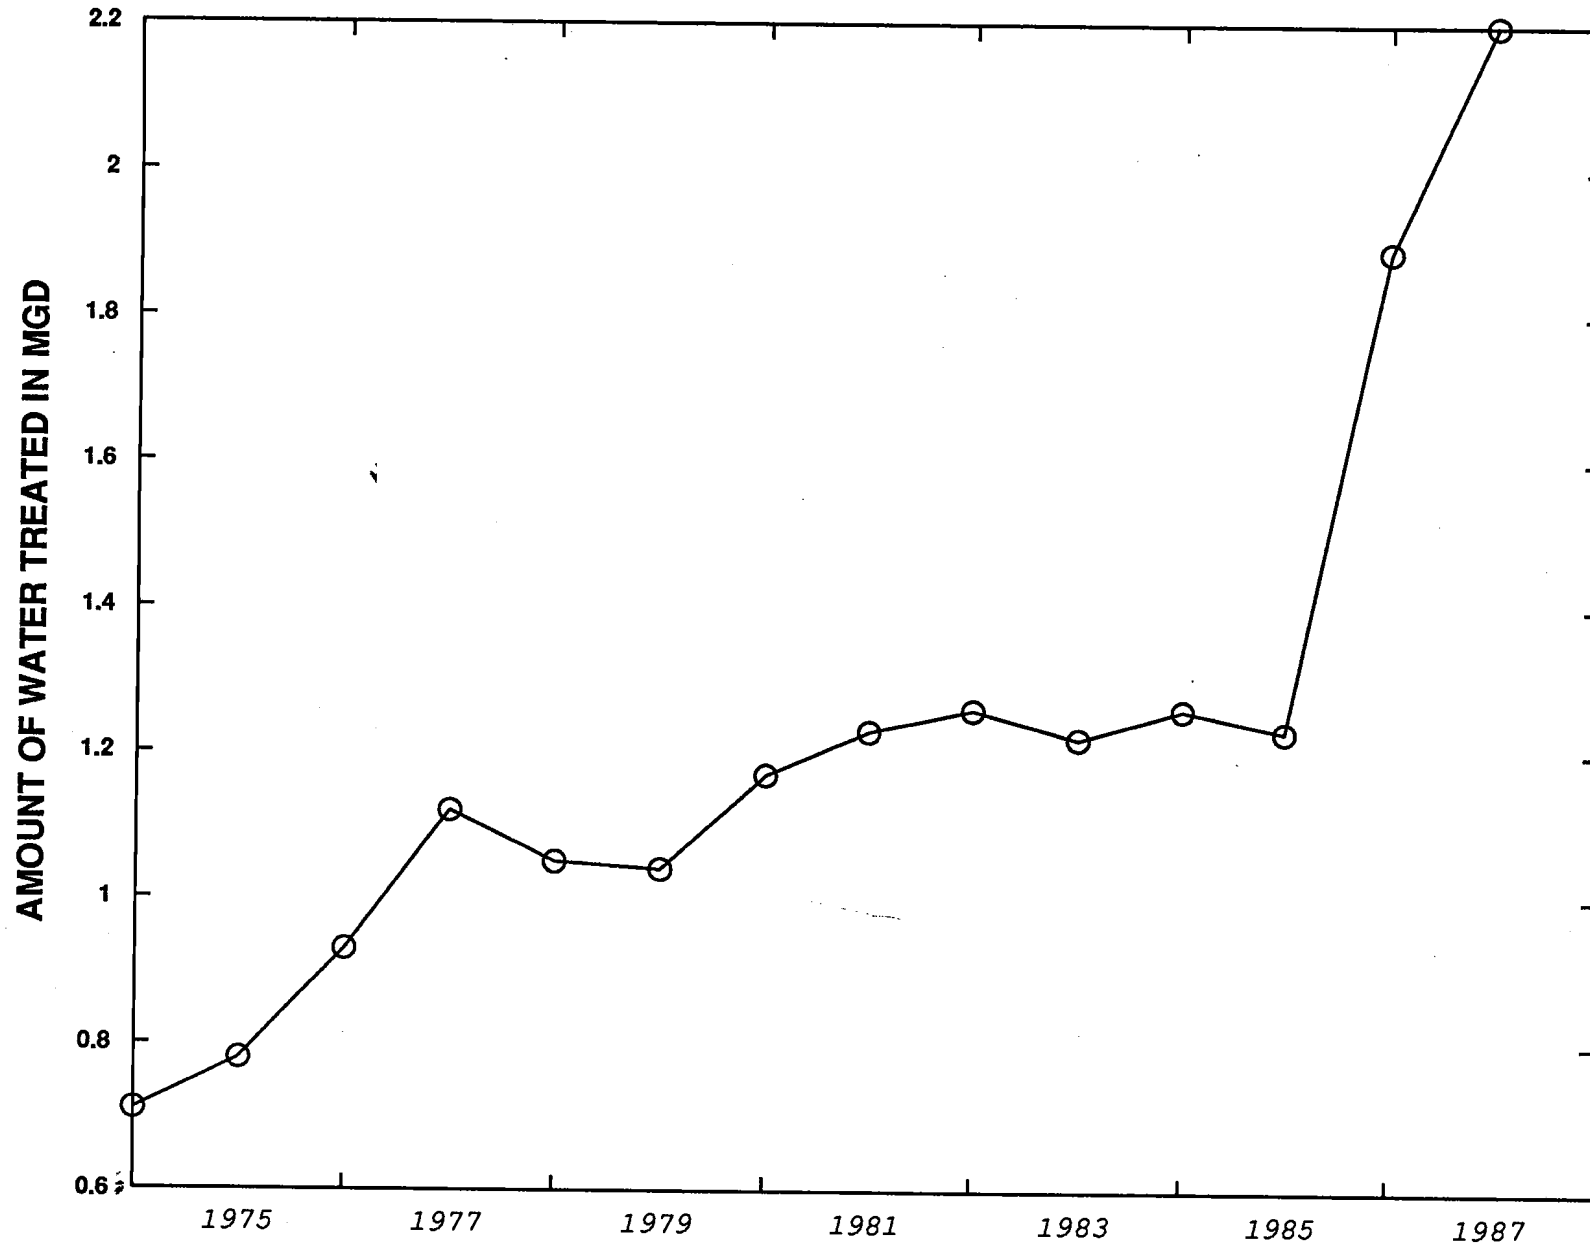


RAW WATER TREATED
HOLCOMB BLVD WTP
CAMP LEJEUNE, NC


Holcomb - Blvd

1975	0.71
1976	0.78
1977	0.93
1978	1.12
1979	1.05
1980	1.04
1981	1.17
1982	1.23
1983	1.26
1984	1.22
1985	1.26
1986	1.23
1987	1.89
1988	2.20


Raw Water Treated
Holcomb Blvd. WTP
Camp Lejeune, NC

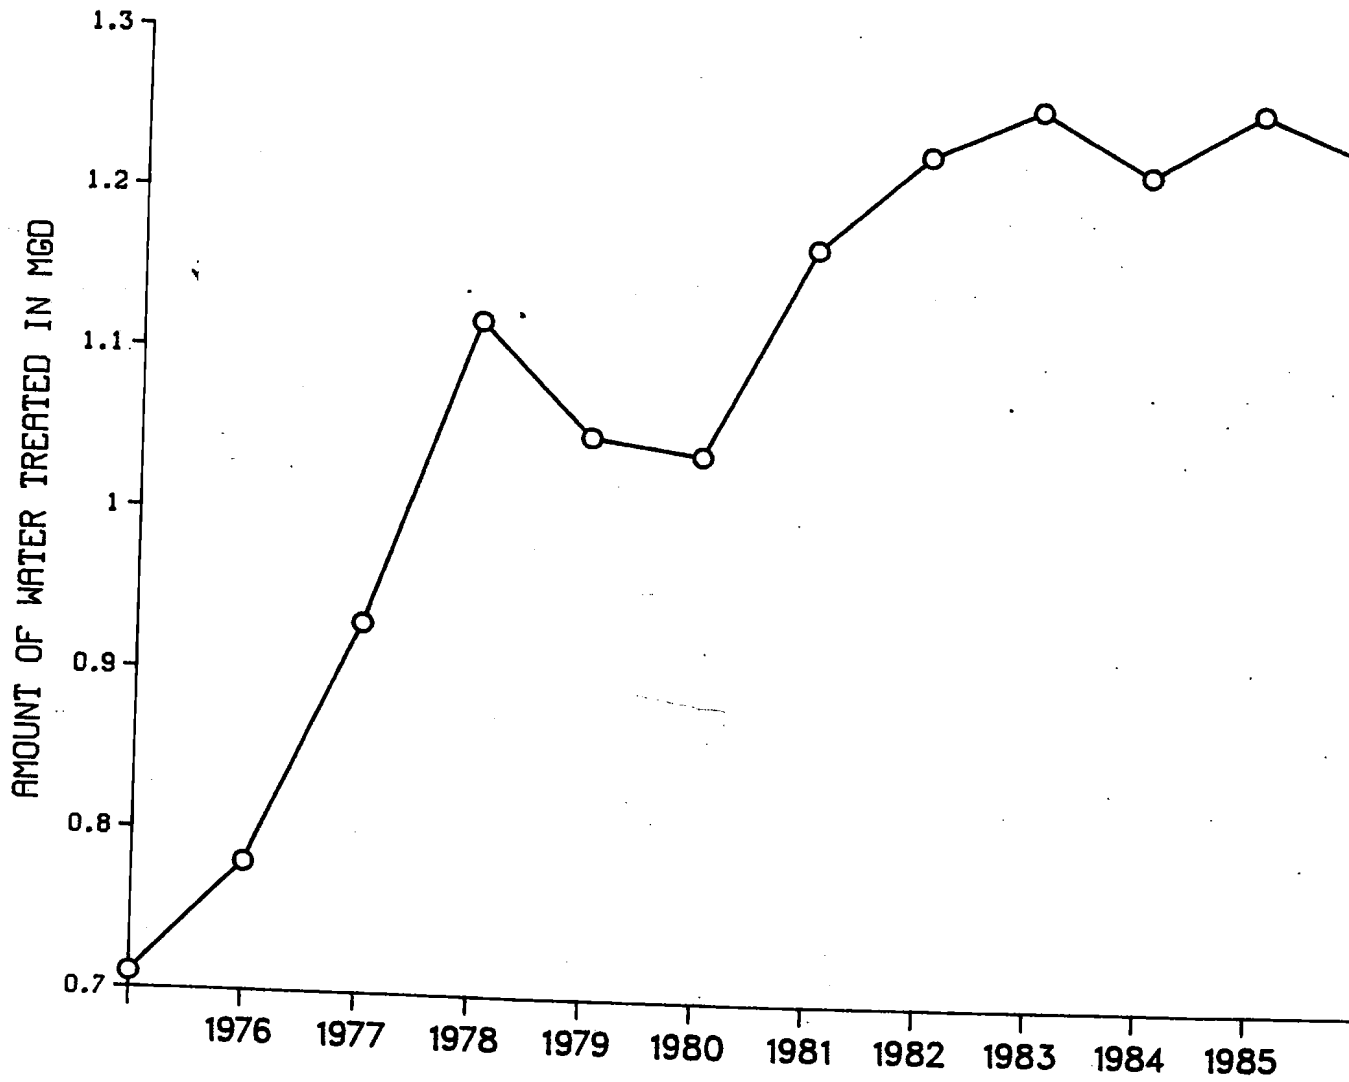


AVERAGE MONTHLY WATER USE FOR CAMP LEJEUNE

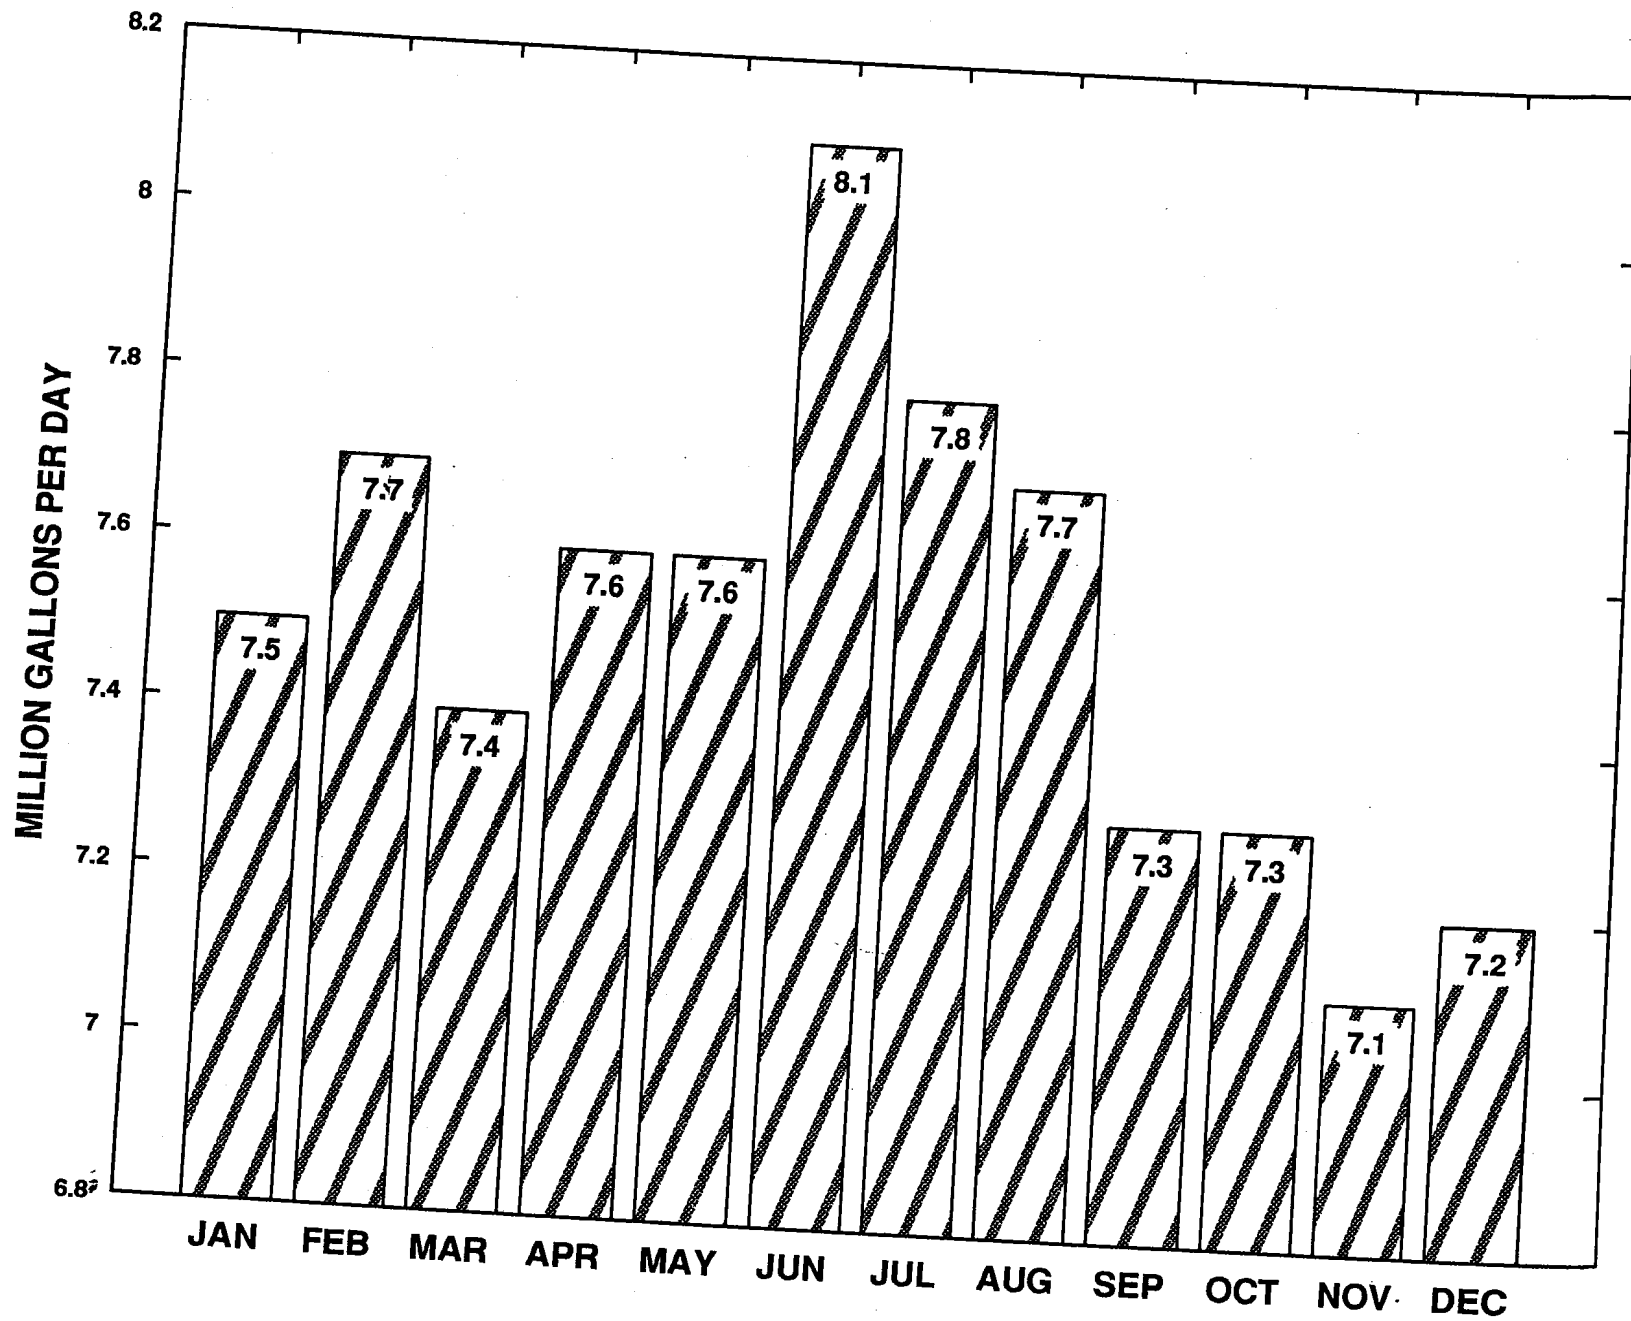

AVERAGE MONTHLY WATER USE FOR CAMP LEJEUNE
FROM 1975 - 1986
IN MILLION GALLONS PER DAY

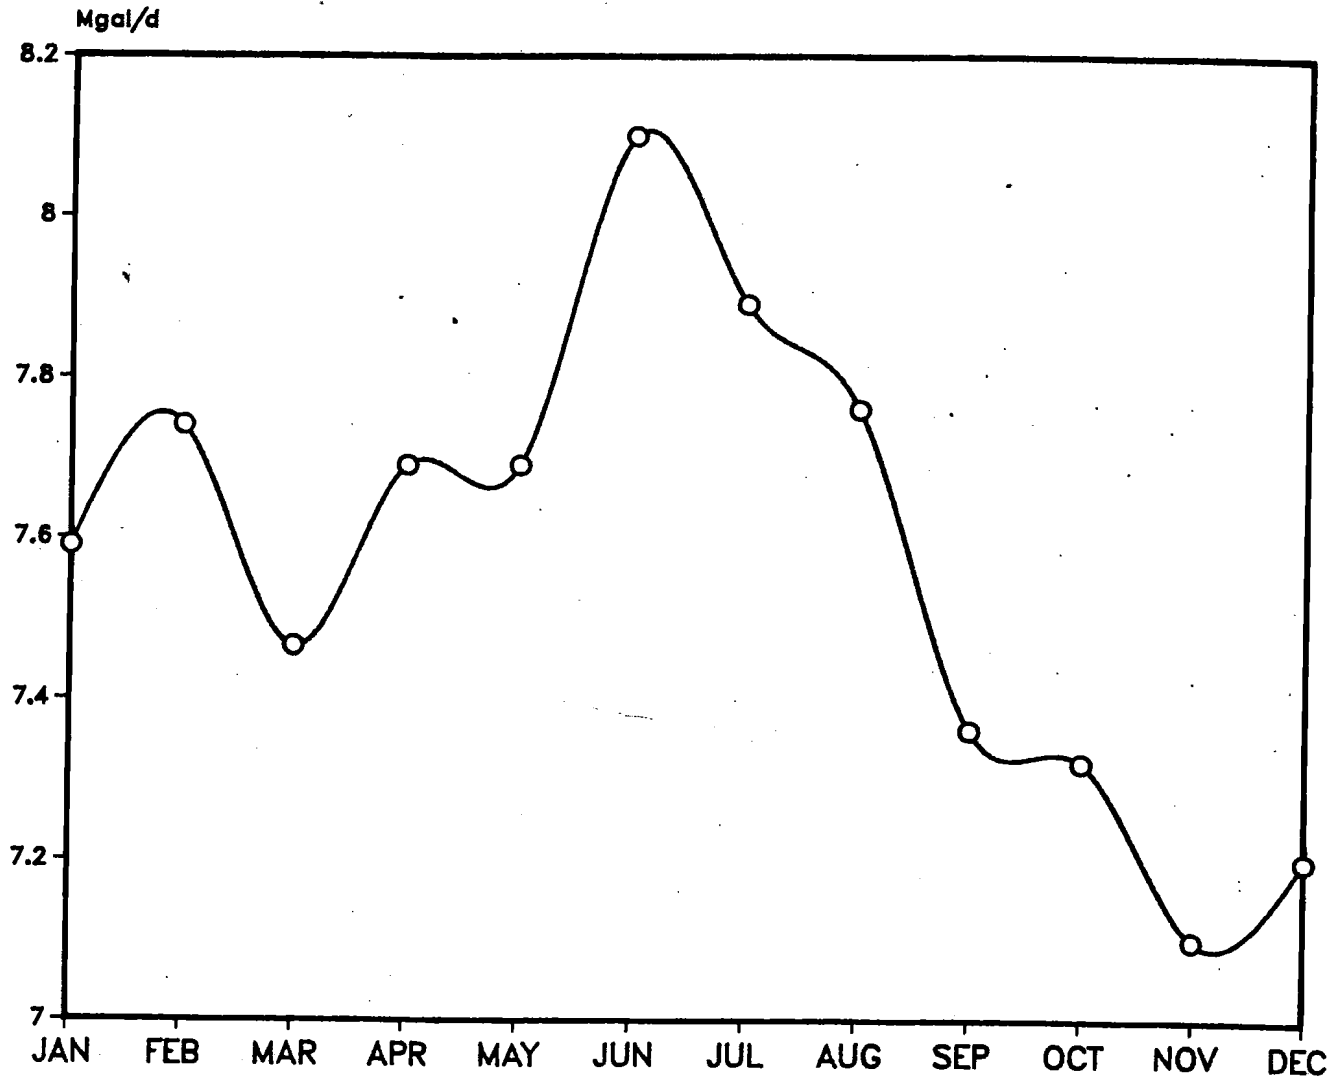

Raw Water Treated Courthouse Bay WTP Camp Lejeune, NC

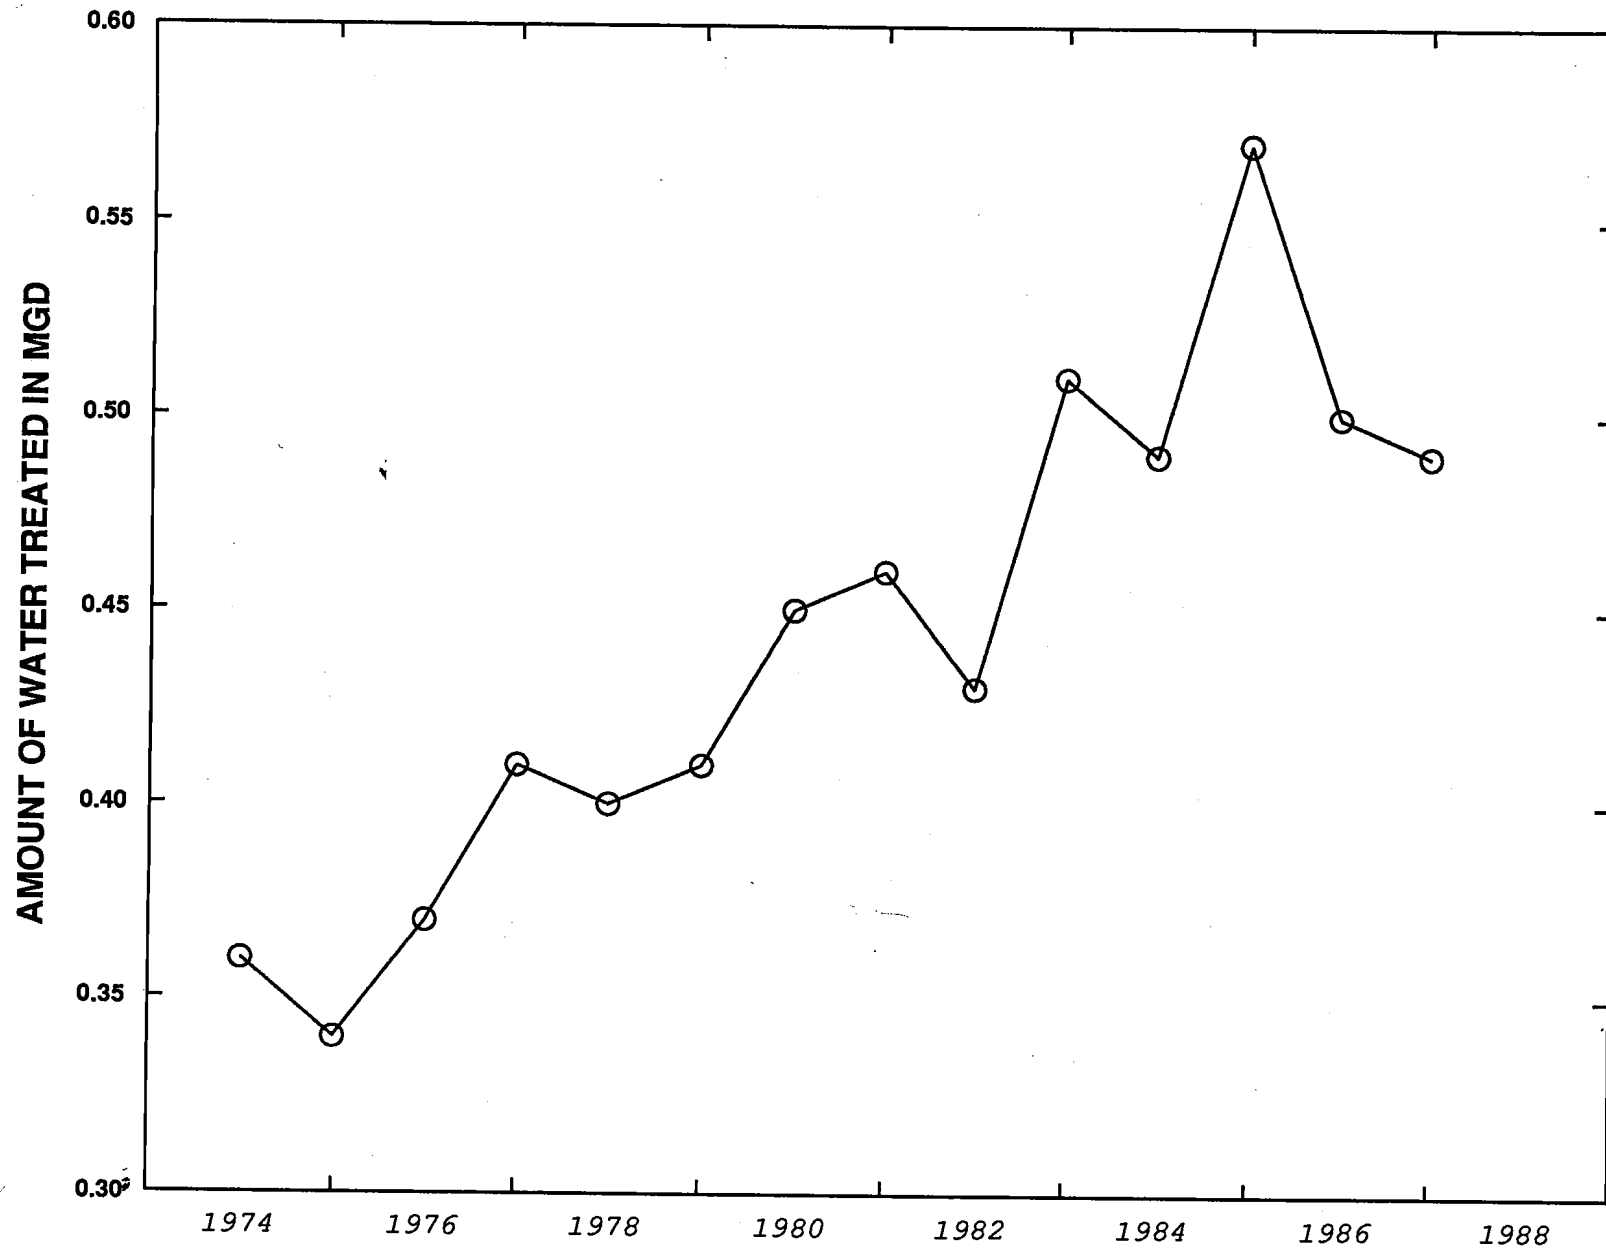


RAW WATER TREATED
COURTHOUSE BAY WTP
CAMP LEJEUNE, NC


Courthouse Bay

1975	0.36
1976	0.34
1977	0.37
1978	0.41
1979	0.40
1980	0.41
1981	0.45
1982	0.46
1983	0.43
1984	0.51
1985	0.49
1986	0.57
1987	0.50
1988	0.49


RAW WATER TREATED
COURTHOUSE BAY WTP
CAMP LEJEUNE, NC

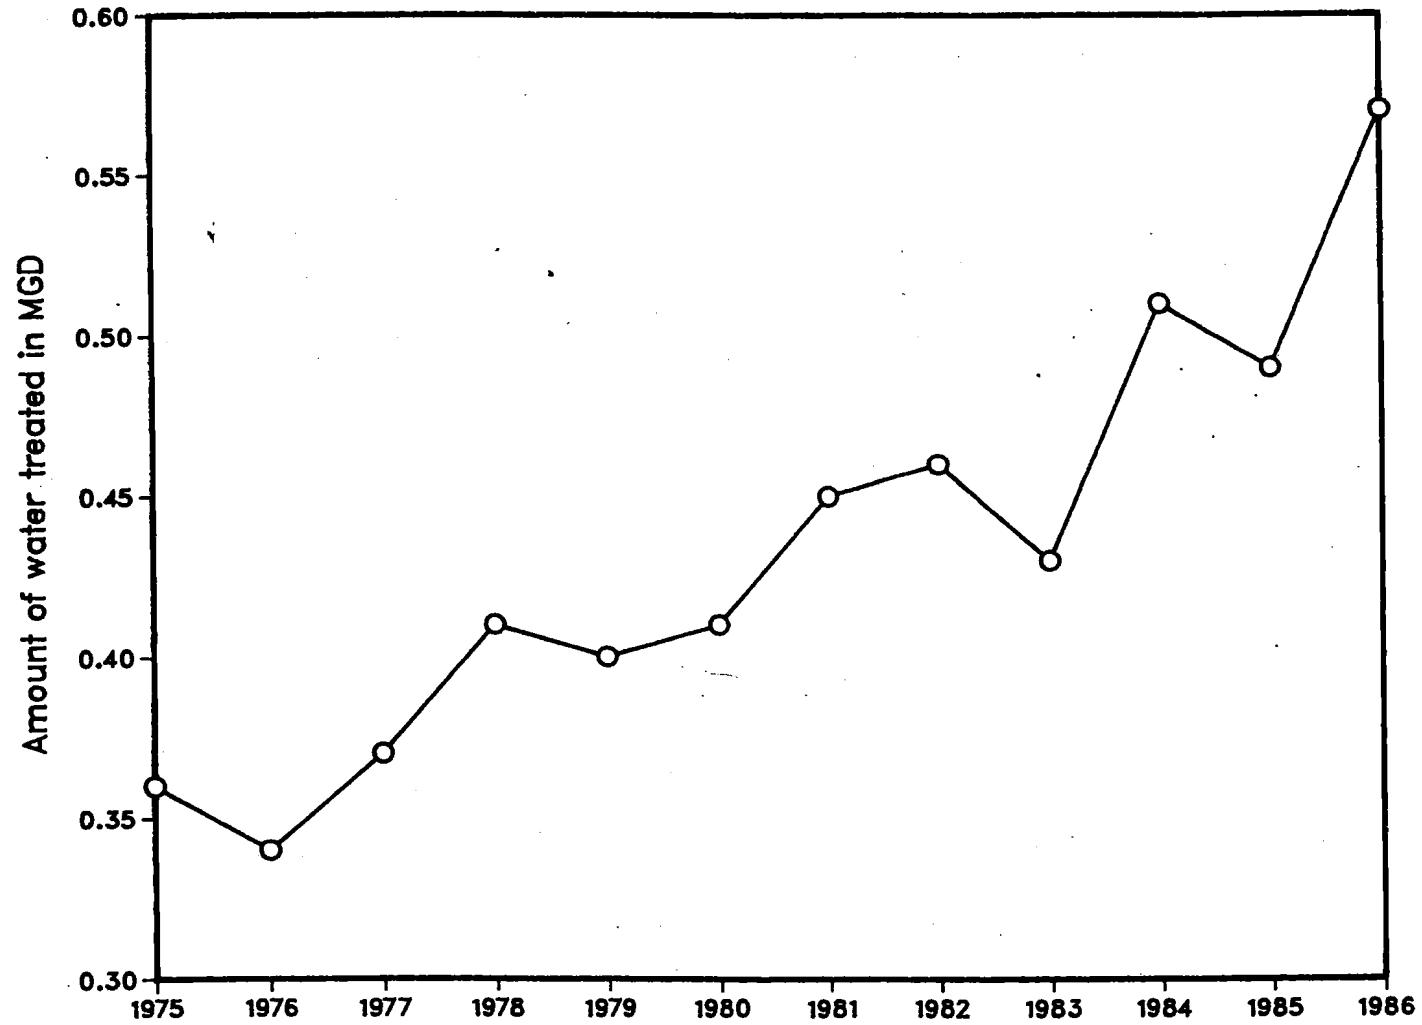

Raw Water Treated Camp Geiger and Air Station WTP Camp Lejeune, NC

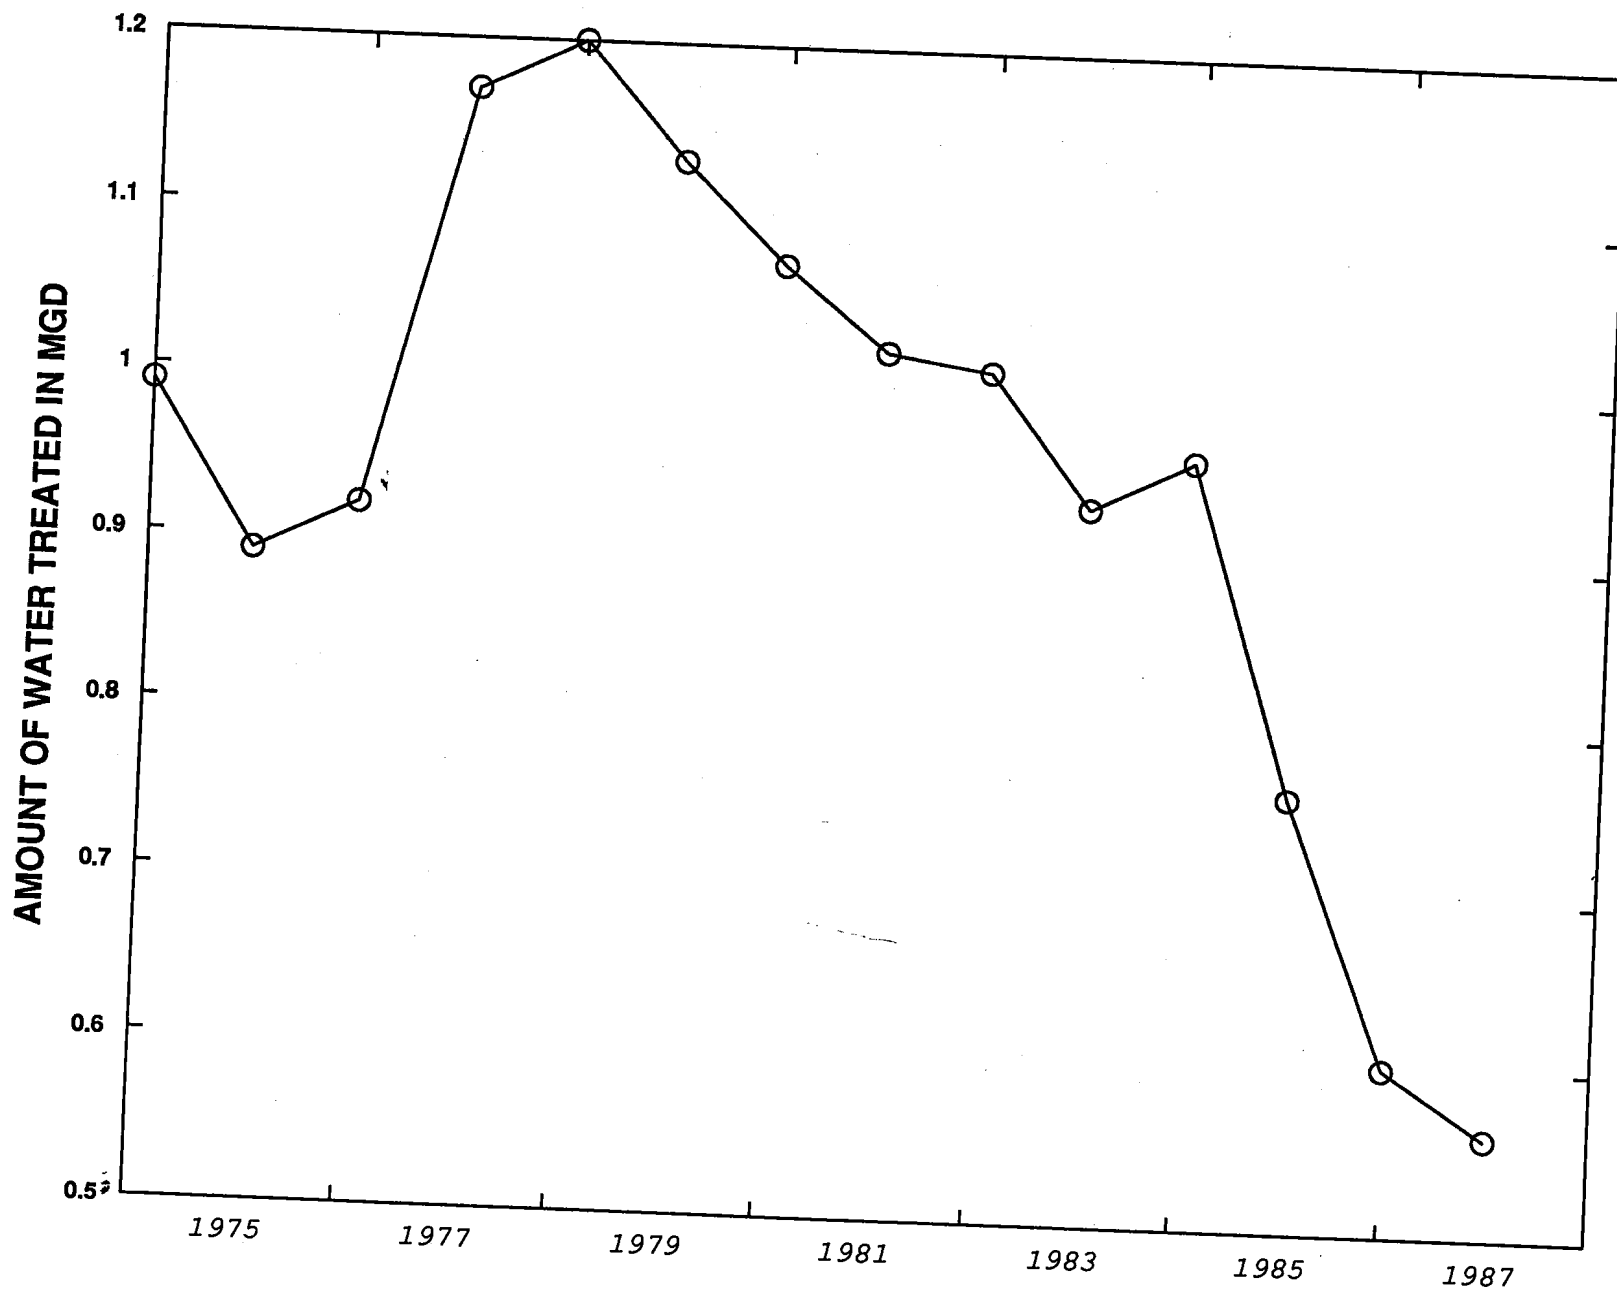

Raw Water Treated
CAMP GEIGER AND AIR STATION WATER TREATMENT PLANTS
Camp Lejeune, NC

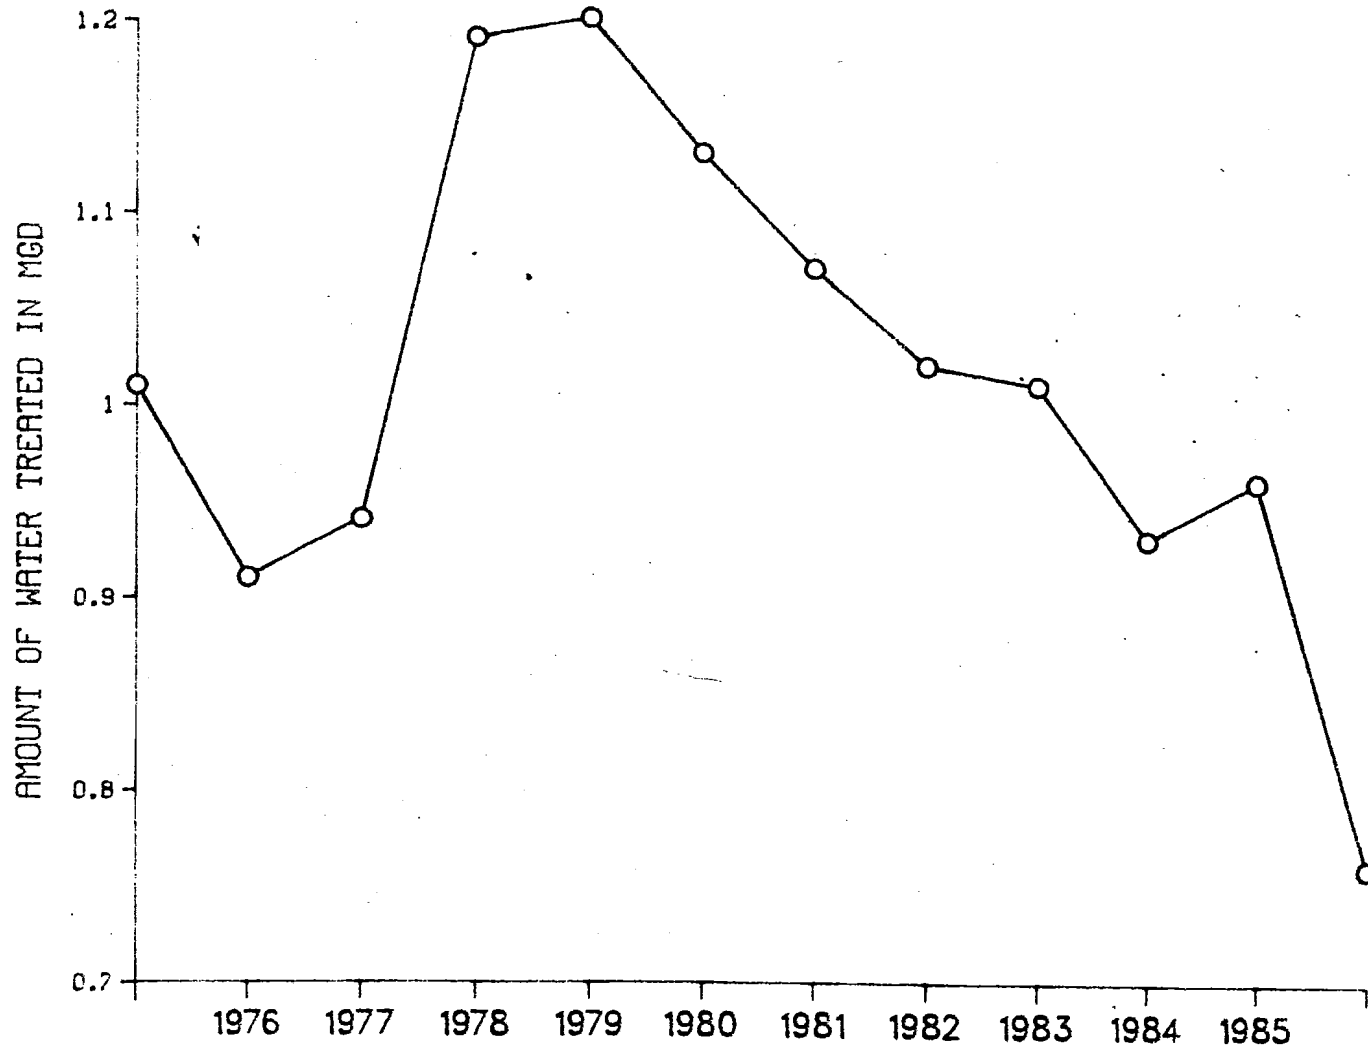

PERCENT RAW WATER TREATED
By WATER TREATMENT PLANTS

Pie
Diag

WTP. 1975

1975

1925

	<u>Mgal/d</u>	<u>Percent</u>
Hadnot Point	3.39	47.5
Holcomb Blvd	0.71	10.0
Tprawn Terrace	0.83	12.0
Montford Point	0.42	5.9
MCAS	0.48	6.7
Rifle Range	0.31	4.3
Courthouse Bay	0.36	5.0
Onslow Beech	0.11	1.5
Camp Gelger	<u>1.51</u>	<u>7.10</u>

Pig
D. 29

WTP. 1978

PERCENT RAW WATER TREATED
By WATER TREATMENT PLANTS
1978

<u>1978</u>	<u>mgal/d</u>	<u>Percent</u>
Hadrat Point	3.71	46.0
Holcomb Blvd	1.12	14.0
TARAWA TERRACE	0.90	11.0
Montford Point	0.42	5.2
MCAS	1.17	14.5
Rifle Range	0.25	3.1
Courthouse Bay	0.41	5.1
OWSLOW BEACH	0.09	1.1

Pir
Died

Percent RAW WATER TREATED
By WATER TREATMENT PLANTS
1988


3

WTP. 1988
1988


	<u>mgal/d</u>	<u>Percent</u>
Hadnot Point	3.34	48.2
Holcomb Blvd	2.20	31.7
Tarawa Terrace		
Montford Point		
MCA5	0.56	8.1
Rifle Range	0.22	3.2
Courthouse Bay	0.49	7.1
Onslow Beach	0.12	1.7

OR

1975

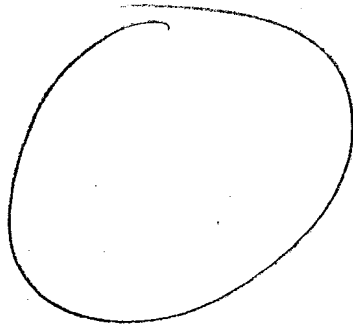


1988

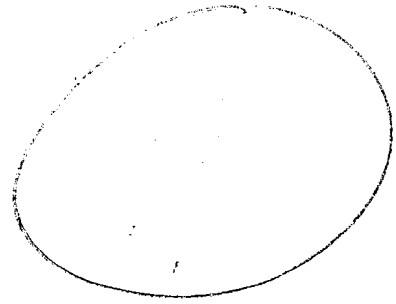


PERCENT RAW WATER TREATED
By WATER TREATMENT PLANTS
CAMP LEJEUNE

Pie Diagrams
↓
showing
%


1978

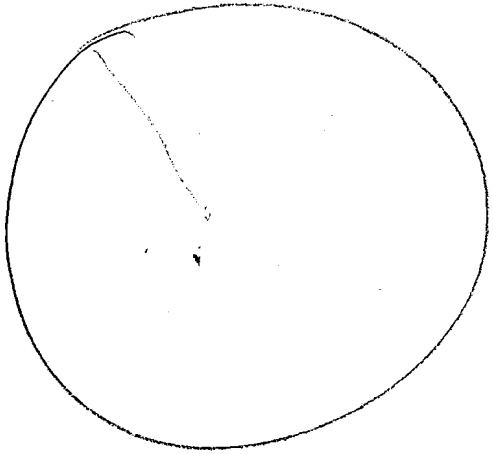

1988

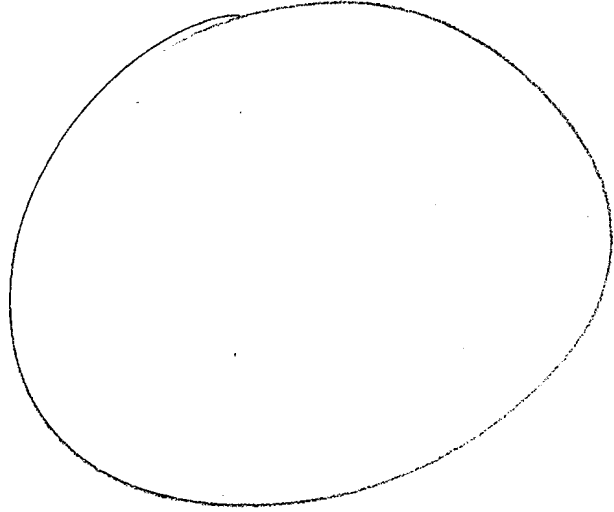

1988

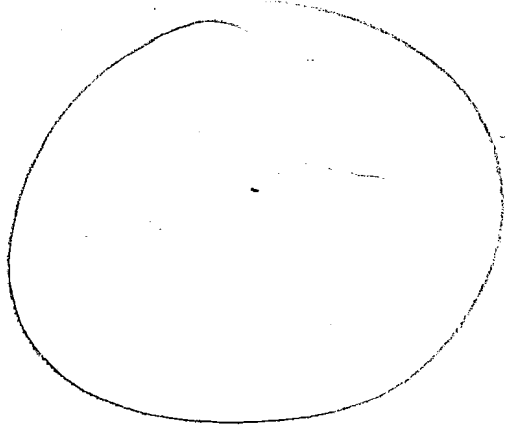


Pie diag for 1978, 1988, 1988
Plus


14

Jan -


AVERAGE MONTHLY WATER USE FOR CAMP LEJEUNE

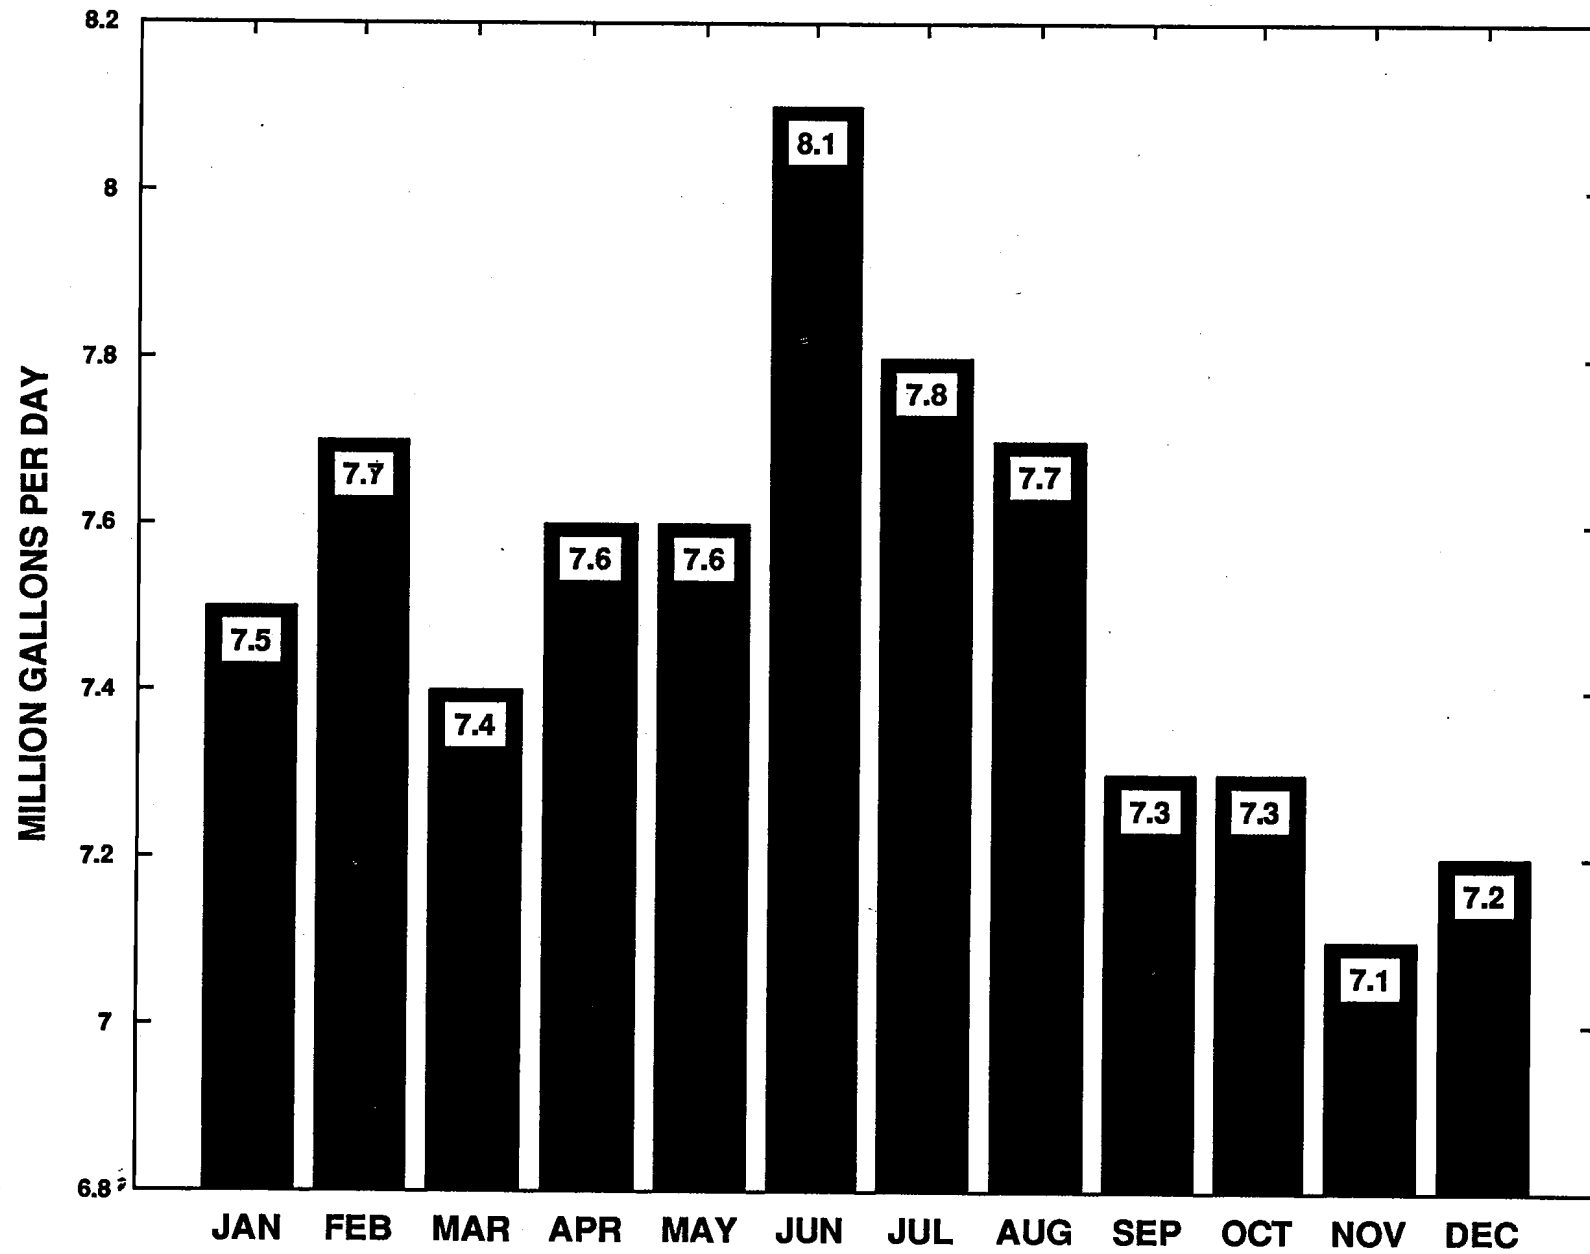


AVERAGE MONTHLY WATER USE FOR CAMP LEJEUNE

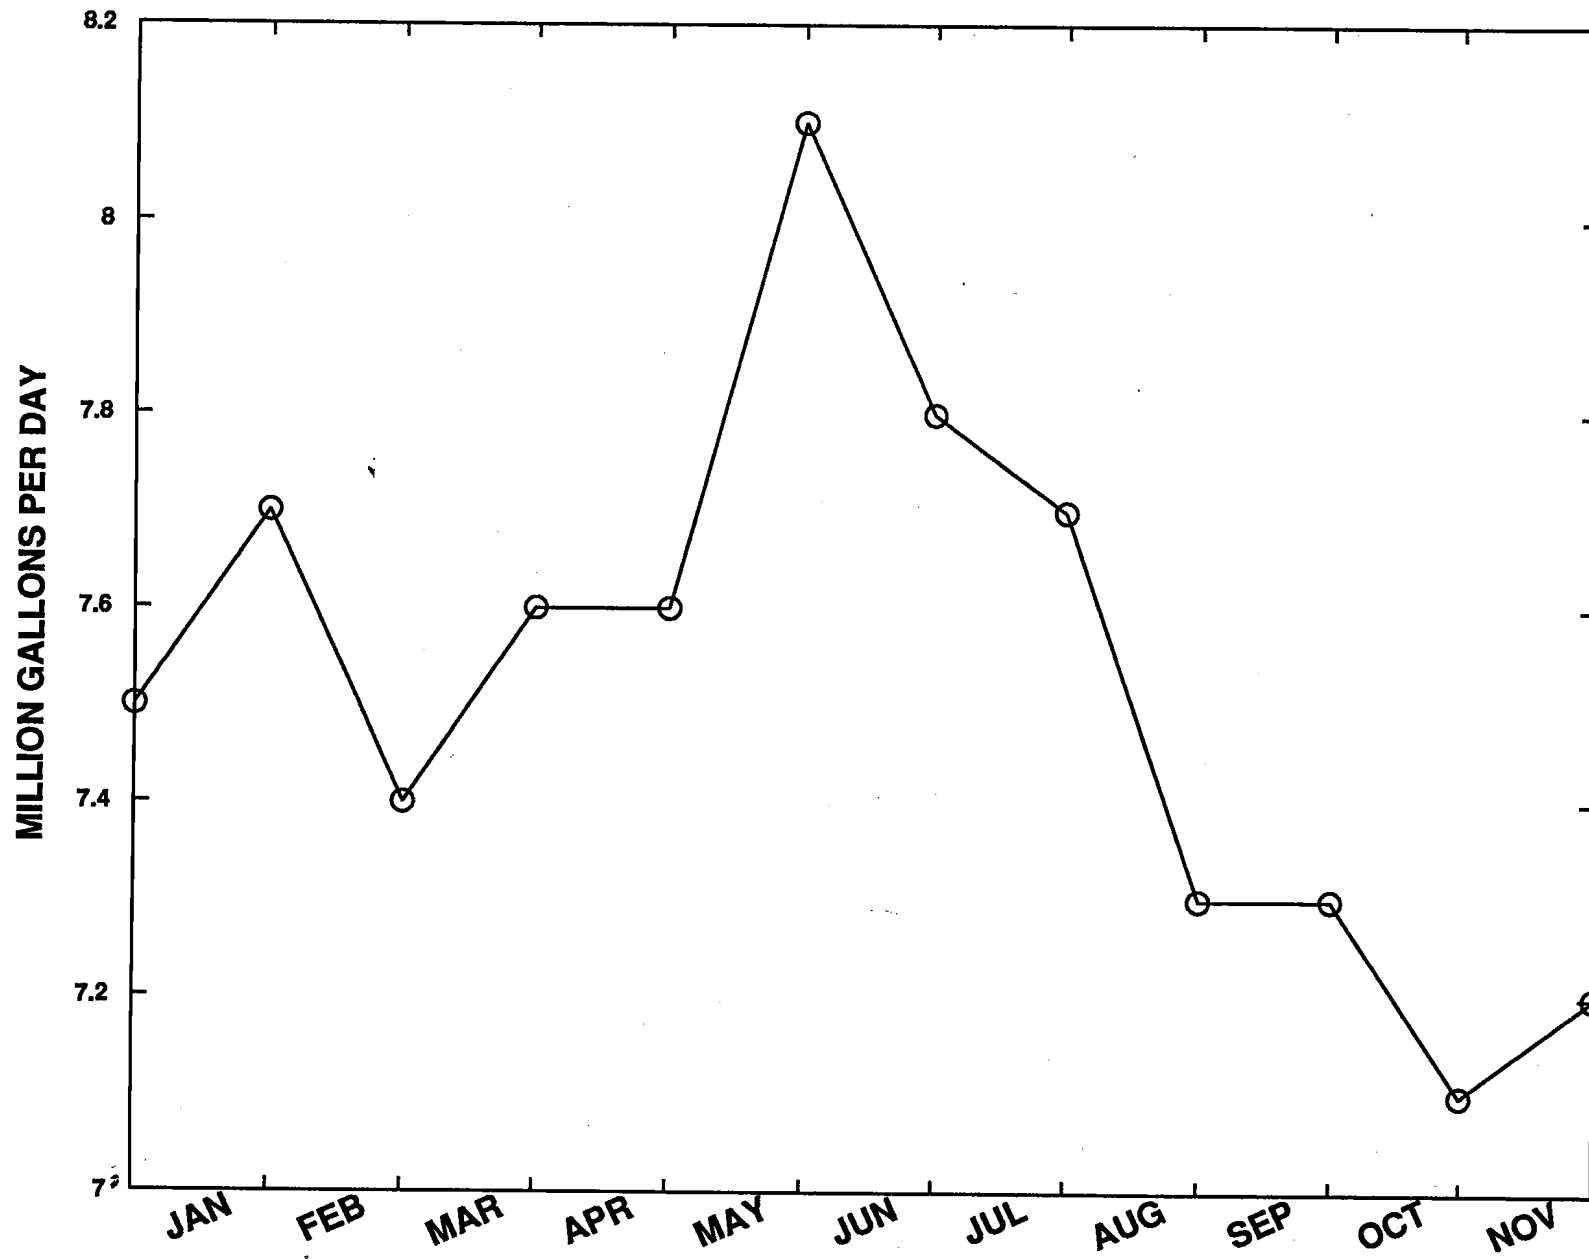


AVERAGE YEARLY WATER USE FOR CAMP LEJEUNE IN MILLIONS OF GALLONS PER DAY

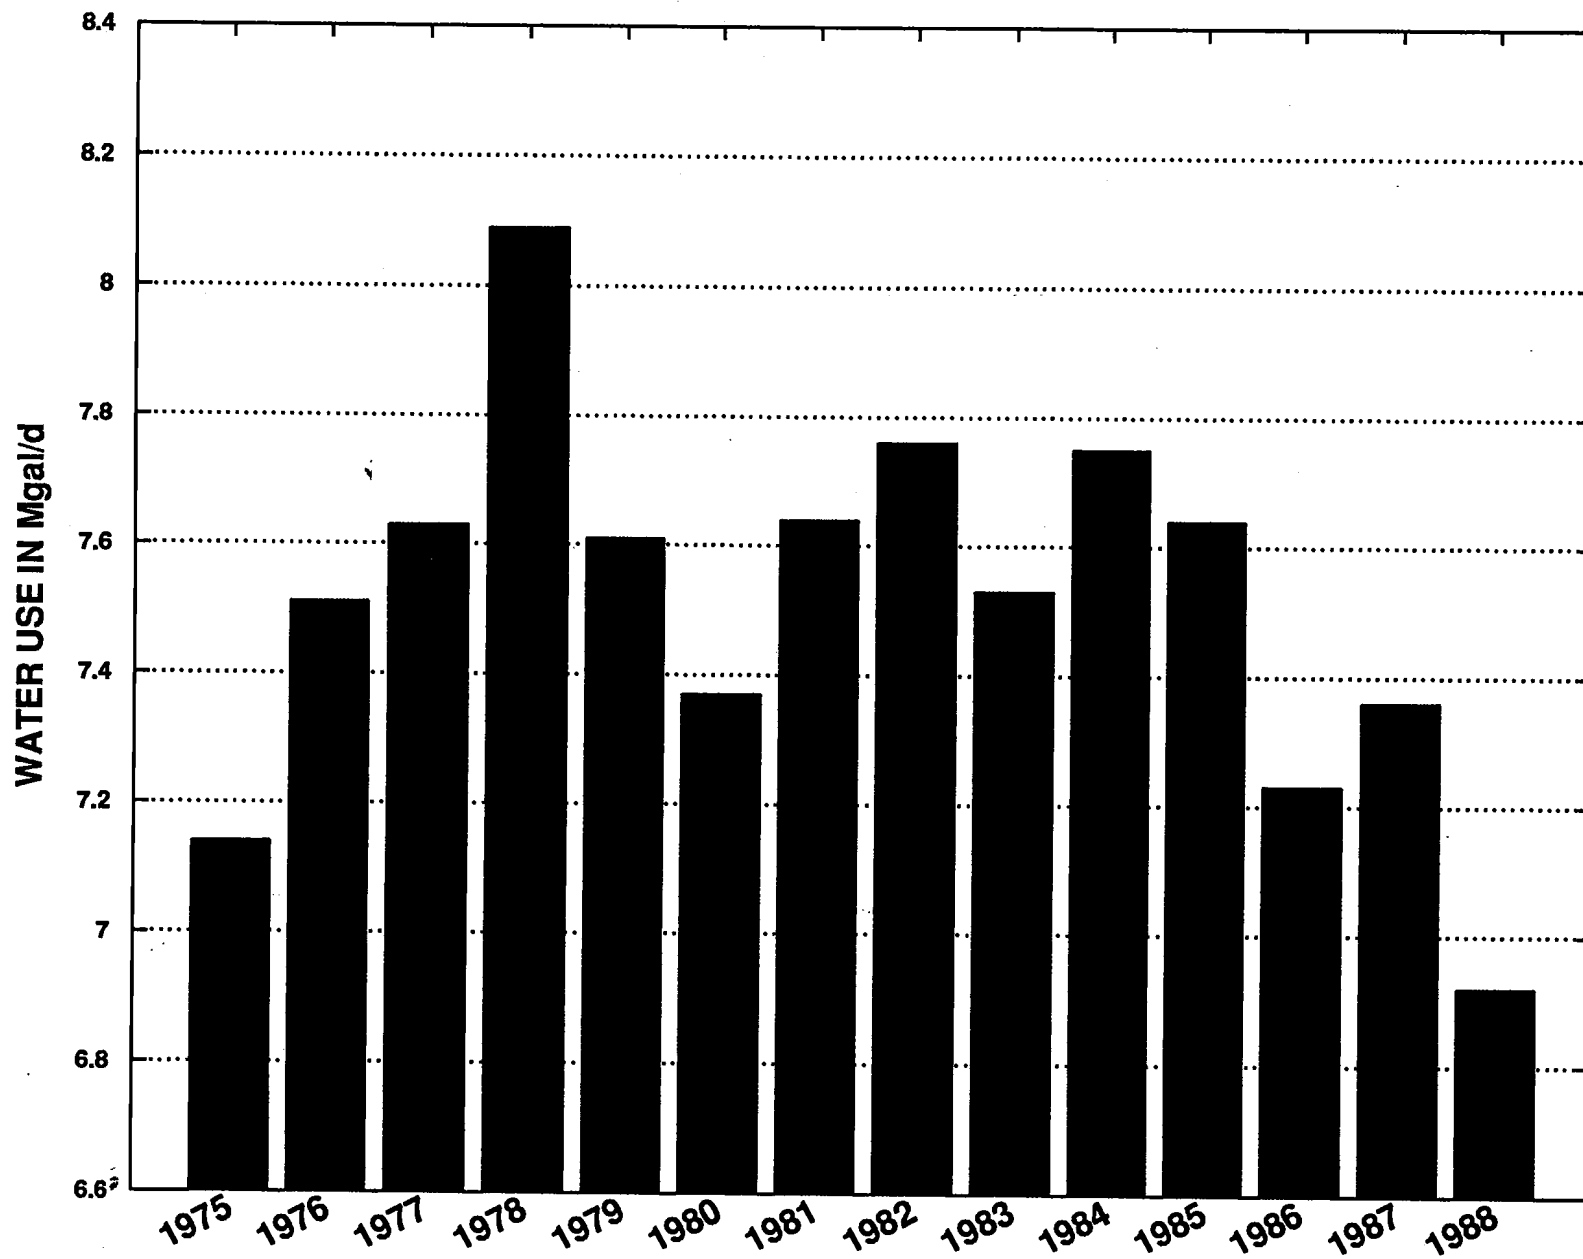


AVERAGE YEARLY WATER USE FOR CAMP LEJEUNE IN MILLIONS OF GALLONS PER DAY

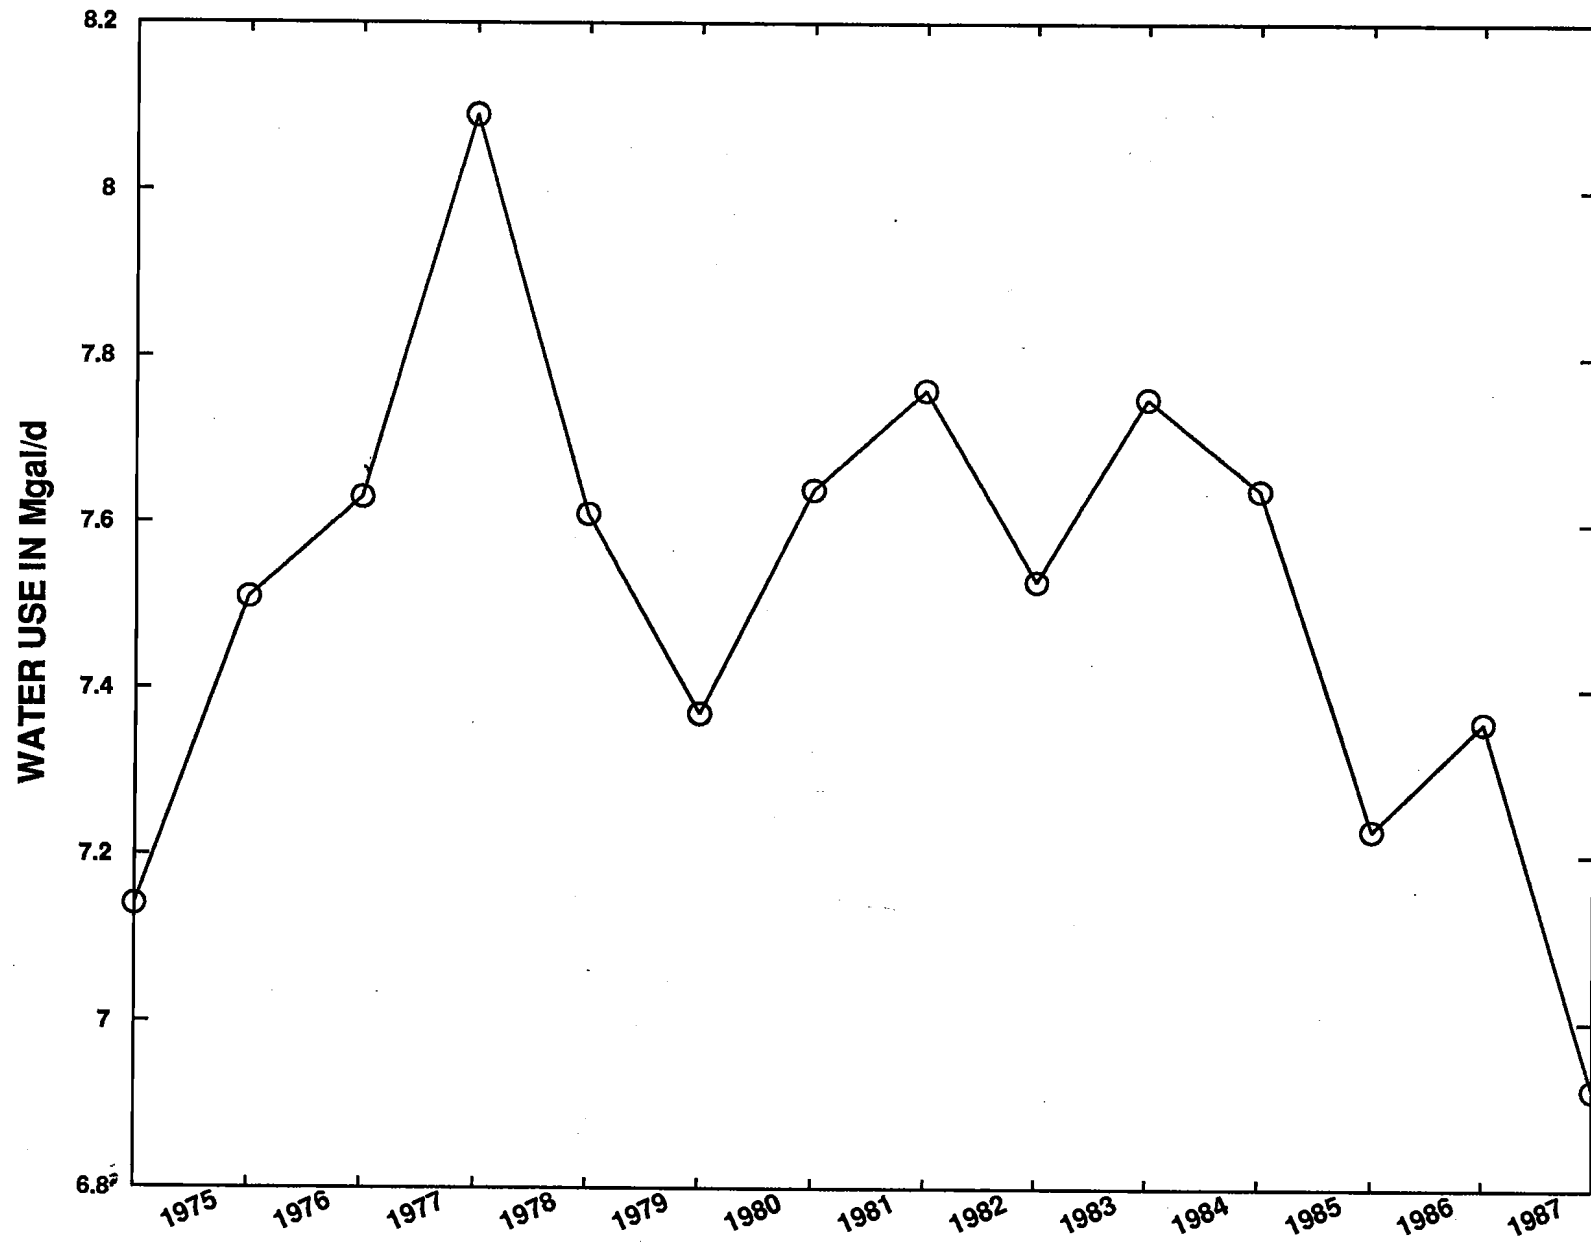

Average Yearly Water Withdrawals for Camp Lejeune

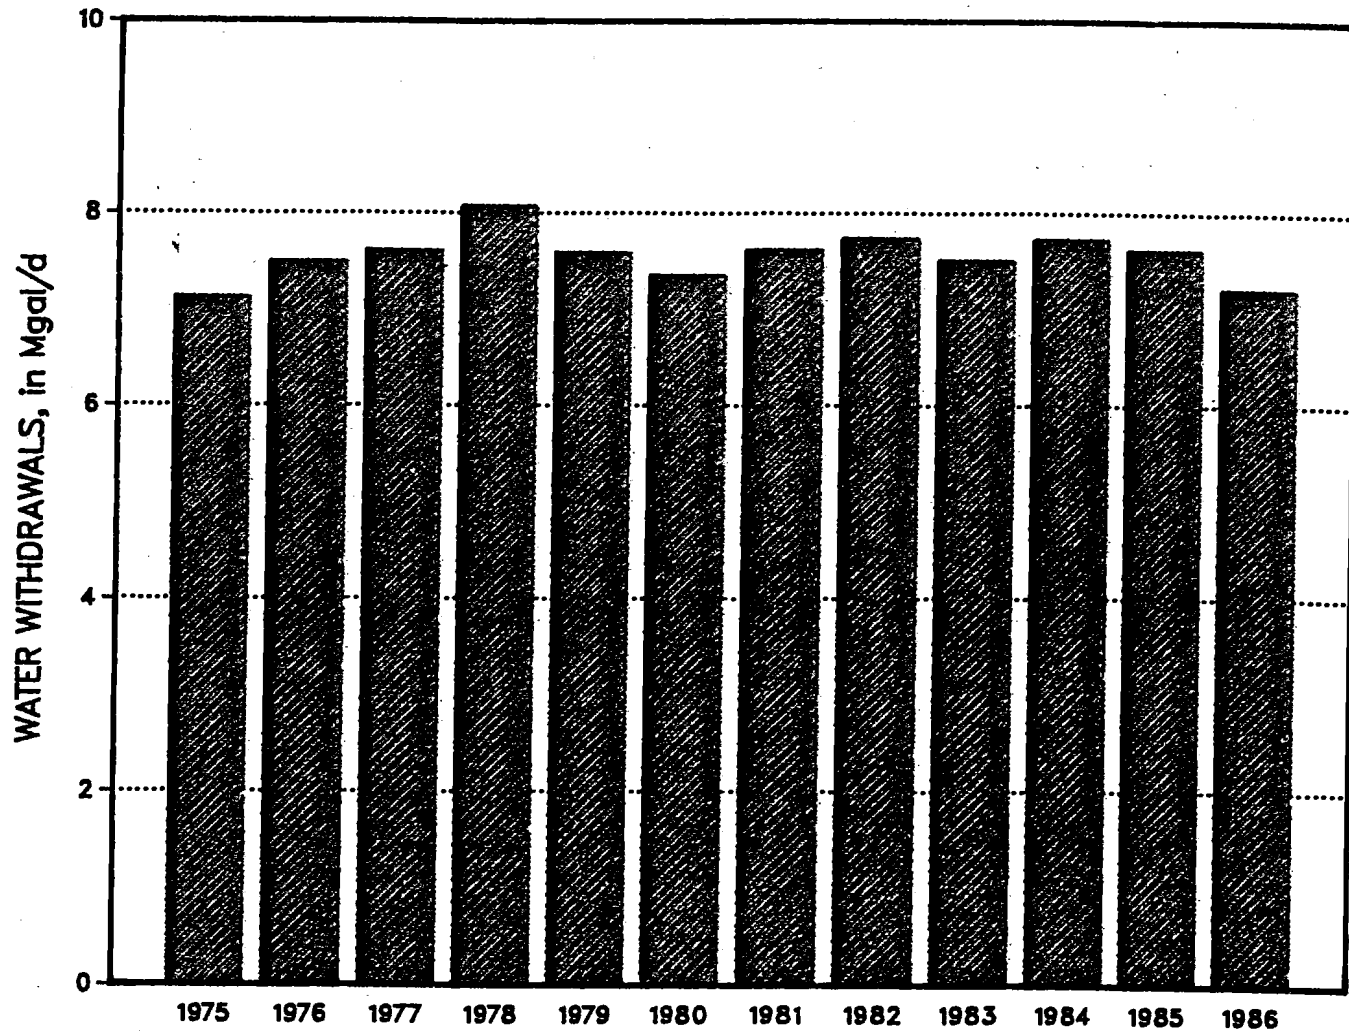


AVERAGE YEARLY WATER USE FOR CAMP LEJEUNE IN MILLIONS PER DAY

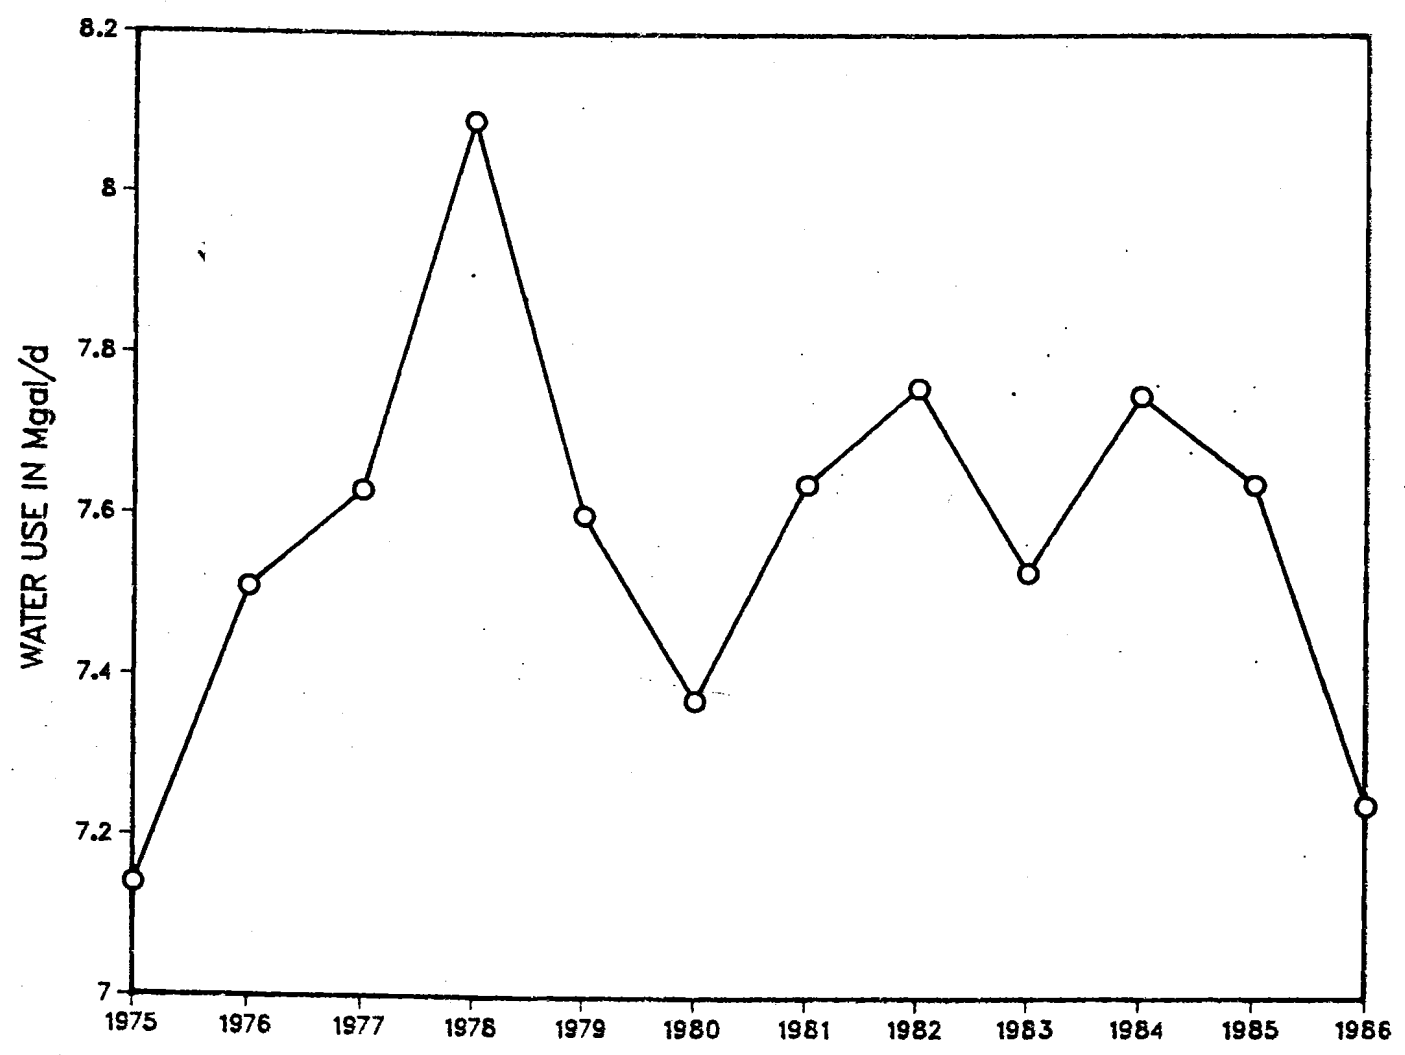


Percent Raw Water Treated By Water Treatment Plants At Camp Lejeune, N.C.


1975

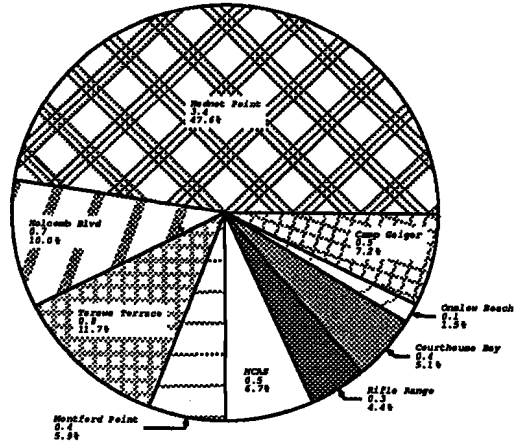

1978

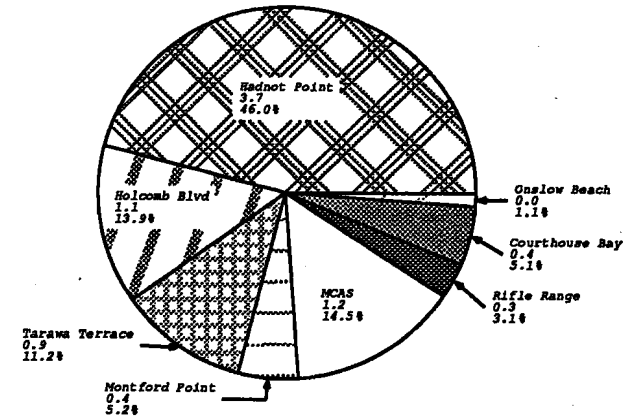


1988

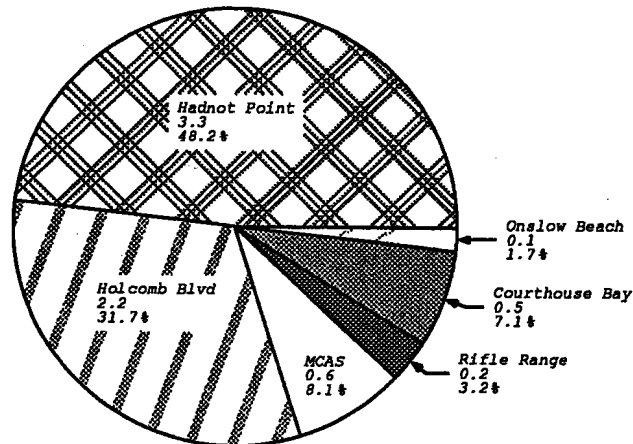


Percent Raw Water Treated By Water Treatment Plants At Camp Lejeune, N.C.

1975

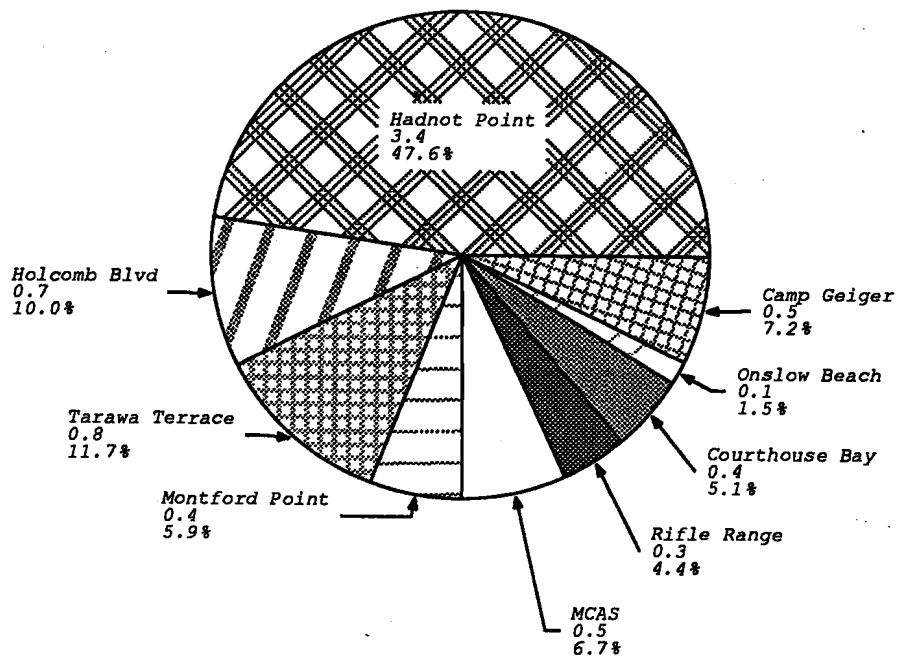


1978

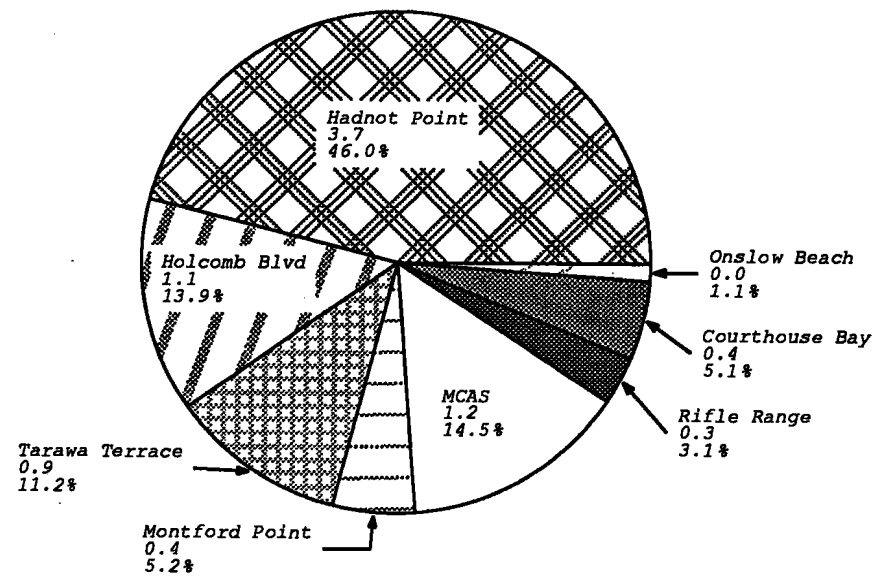

Percent Raw Water Treated By Water Treatment Plants At Camp Lejeune, N.C.

1975

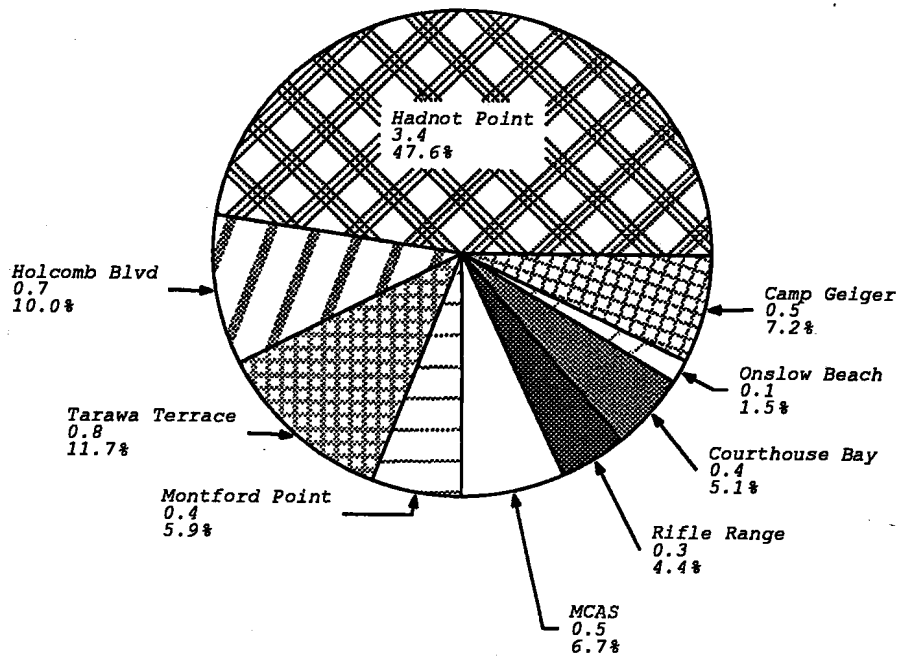

1988

